SIEMENS





Presentation example PME7...

Presentation example LME7...

PME71.401...

Program module for burner control LME71.000

User Documentation

Application:

- 1-stage or 2-stage, direct ignited forced draft burners
- E.g. for burners to EN 676

The PME7... and this User Documentation are intended for use by OEMs which integrate the LME7... with PME7... in their products.



Note!

This documentation is only valid together with LME7... Basic Documentation (P7105)!

Contents

•	Supplementary documentation	3
2	Warning notes	4
3	Typographical conventions	4
4	Program sequence PME71.401	5
5	List of phase display	6
6	Fuel trains (examples)	7
6.1	Gas direct ignition (G), 1-stage	7
6.2	Gas direct ignition (G), 2-stage	7
7	Input gas pressure switch-min	7
7 8	Input gas pressure switch-min Time table and settings	
•		8
8	Time table and settings	8 9
8 9	Time table and settings Inputs and outputs / internal connection diagram	9
8 9 10	Time table and settings Inputs and outputs / internal connection diagram	9 10

1 Supplementary documentation

Product type	Type of documentation	Documentation number
LME	Environmental Product Declaration	E7105
PME	Environmental Product Declaration	E7105.1
LME7	Data Sheet	N7105
LME	Product Range Overview	Q7010
LME7	Basic Documentation	P7105

2 Warning notes



Warning!

The safety, warning and technical notes given in the Basic Documentation on the LME7... (P7105) apply fully to the present document also!

To avoid injury to persons, damage to property or the environment, the following warning notes must be observed!

The LME7... are safety devices! Do not open, interfere with or modify the unit. Siemens does not assume responsibility for damage resulting from unauthorized interference!

3 Typographical conventions

Safety notes

This User Documentation contains notes which must be observed to ensure your personal safety and to protect the product and the connected equipment. The instructions and notes are highlighted by warning triangles-or a hand symbol and are presented as follows, depending on the hazard level:

	٨	
	1	1
_	•	_

Warning means that death, severe personal injury or substantial

damage to property can occur if adequate precautionary

measures are not taken



Note draws your attention to **important information** on the

product, on product handling, or to a special part of the

documentation

Qualified personnel

Only **qualified staff** are allowed to install and operate the equipment. Qualified staff in the context of the safety-related notes contained in this document are persons who are authorized to commission, ground and tag devices, systems and electrical circuits in compliance with established safety practices and standards.

Correct use

Note the following:

The device may only be used on the applications described in the technical documentation and only in connection with devices or components from other suppliers that have been approved or recommended by Siemens.

The product can only function correctly and safely if shipped, stored, set up and installed correctly, and operated and maintained as specified.

4 Program sequence PME71.401...

 \rightarrow For fuel trains **G**

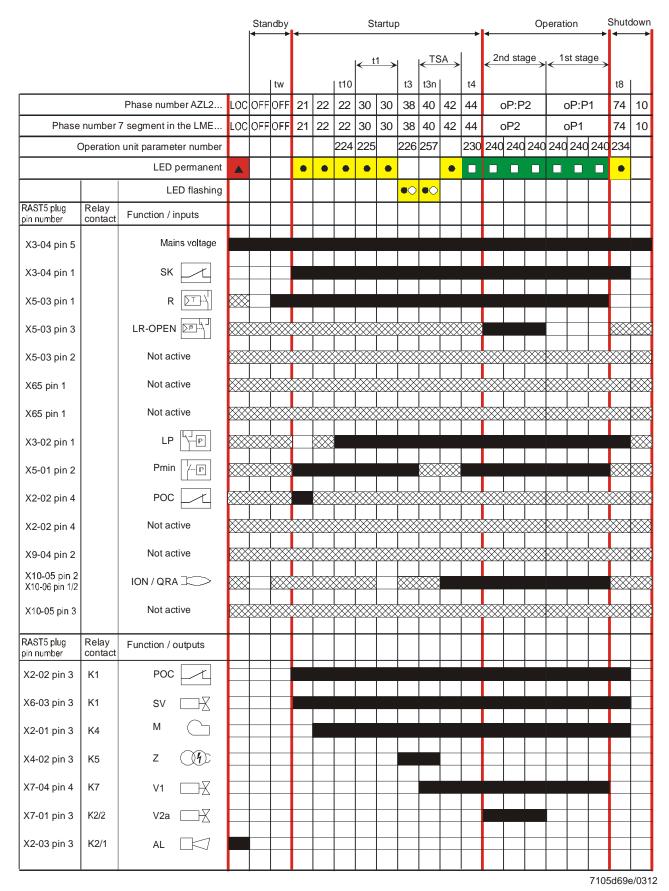


Figure 1: Program sequence

5 List of phase display

Phase number of display 7-segment AZL2		LED	Function
LOC	LOC	OFF	Lockout phase
Standby			
OFF	OFF	OFF	Standby, waiting for heat request
P08	Ph08	OFF	Power ON/test phase (e.g. detector test)
Startup			
P21	Ph21	Yellow	Safety valve ON, air pressure switch in no-load position Test if POC closed (timeout/lockout after 5 seconds)
P22	Ph22	Yellow	Part 1: Fan motor ON Part 2: Specified time air pressure switch Message (timeout), stabilization air pressure switch
P30	Ph30	Yellow	Part 1: Prepurge time without extraneous light test Part 2: Prepurging with extraneous light test (2.1 seconds)
P38	Ph38	Yellow	Preignition time
P40	Ph40	Yellow flashing	Postignition time
P42	Ph42	Green	Flame detection
P44 Ph44 Green		Green	Interval: End of safety time and load controller release
Operation			
oP1	oP:P1	Green	Operation (first stage)
oP2	oP:P2	Green	Operation (second stage)
Shutdown			
P10	Ph10	OFF	Home run
P74	Ph74	Yellow	Postpurge time
Safety shuto	down phases		
P01	Ph01	Yellow / red	Under voltage / over voltage
P02	Ph02	Yellow	Safety shutdown (e.g. open safety loop) → Lockout
P04	Ph04	Green / red	Extraneous light in standby
P90	Ph90	Yellow	Gas pressure switch-min open → safety shutdown and start prevention

6 Fuel trains (examples)

6.1 Gas direct ignition (G), 1-stage

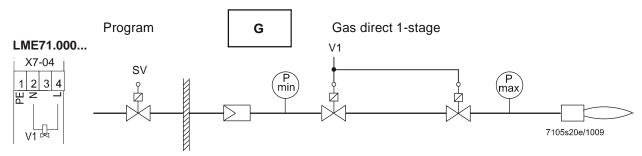


Figure 2: Fuel train gas direct ignition (G), 1-stage

6.2 Gas direct ignition (G), 2-stage

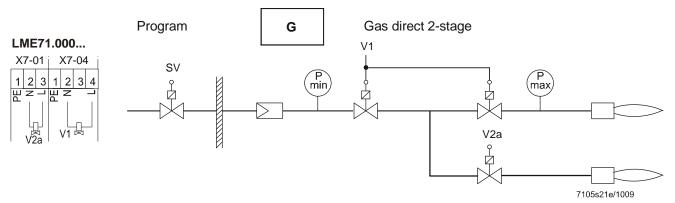


Figure 3: Fuel train gas direct ignition (G), 2-stage

7 Input gas pressure switch-min

Behavior in the event gas pressure switch-min fails (terminal X5-01 pin 2 and 3) If gas pressure switch-min fails, safety shutdown is triggered and startup prevented until gas pressure switch-min closes again.

During start prevention, the yellow LED is lit and the safety circuit is active. Burner control operates in phase 90.

8 Time table and settings

Туре		Times in seconds									
		TSA	t1	t3	t3n	t4	t8	t10			
PME71.401	tw	max.	P225	P226	P257	P230	P234	P224	1)	2)	3)
		max.	min.	min.	approx.	min.	min.	approx.			
Requirements	2.5	3	30	2	2.5	8	0	15			
Factory setting		t3n+0.45	29.106+2.1	2.058	2.205+0.3	8.232	0	13.818			
Max.	2.5	14	1237+2.1	37.485	13.23+0.3	74.97	1237	13.818	1	0.45	0.45
Min.			0+2.1	1.029	0+0.3	3.234	0	0	0.3	0.3	
Step size			4.851	0.147	0.147	0.294	4.851	0.254			

Function parameter	Parameter number	Factory setting
Repetition in the event of loss of flame during operation	240	0
0 = none		
1 = none		
2 = 1 x repetition		

Legend

tw	Waiting time
TSA	Safety time
t1	Prepurge time
t3	Preignition time
t3n	Postignition time parameter 257 +0.3 seconds
t4	Interval: End of safety time - load controller release
t8	Postpurge time
t10	Specified time air pressure switch message (timeout)

- 1) Reaction time to a change of signal by the air pressure switch contact (opens) and flame-out response time in the event of loss of flame
- 2) Reaction time to a change of signal by the inputs (e.g. pressure switch-min)
- 3) Flame detection time

9 Inputs and outputs / internal connection diagram

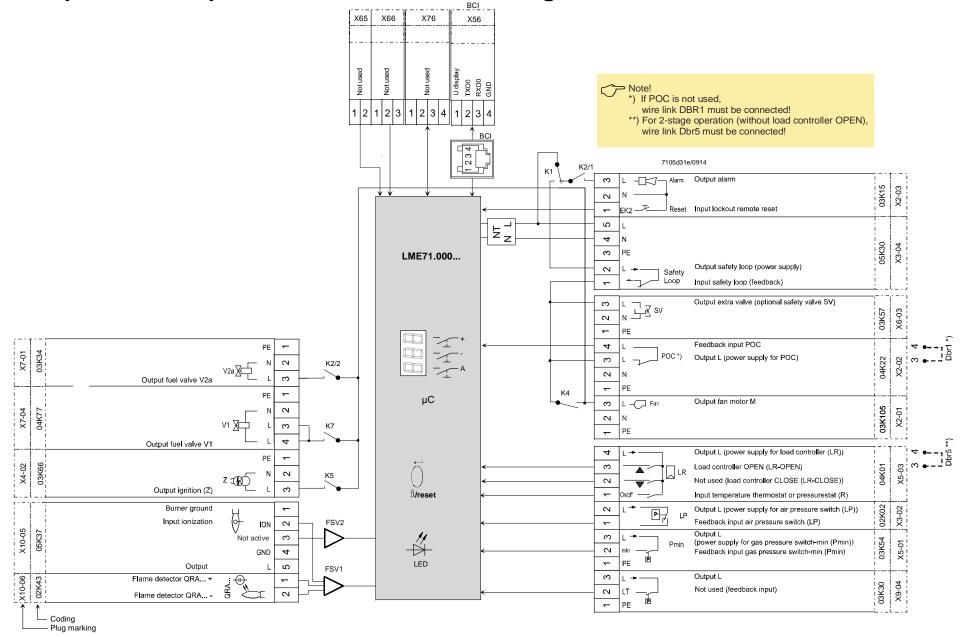


Figure 4: Inputs and outputs / internal connection diagram

10 Parameter list (AZL2...)

Parameter	Parameter	Edit	Value	range			Password level		
number			Min.	Max.	Resolution	Factory setting	reading from level	Password level writing from level	
000	Internal parameter								
41	Heating engineer's password (4 characters)	Edit	xxxx	xxxx				OEM	
42	OEM's password (5 characters)	Edit	xxxxx	xxxxx				OEM	
60	Backup/restore	Edit						SO	
100	General								
102	Identification date	Read only					Info		
103	Identification number	Read only	0	9999	1	0	Info		
113	Burner identification	Edit	х	XXXXXXX	1		Info	SO	
140	Mode display of display and operating unit AZL2 1 = standard (program phase) 2 = flame 1 (QRA/ION) 3 = flame 2 (QRB/QRC) ⇒ not used 4 = active power (power value)	Edit	1	4	1	1	SO	SO	
164	Number of startups resettable	Resettable	0	999999	1	0	Info	Info	
166	Total number of startups	Read only	0	999999	1	0	Info		
170.00	Switching cycles relay contact K12	Read only	0	999999	1	0	Info		
170.01	Switching cycles relay contact K11	Read only	0	999999	1	0	Info		
170.02	Switching cycles relay contact K2	Read only	0	999999	1	0	Info		
170.03	Switching cycles relay contact K1	Read only	0	999999	1	0	Info		
171	Max. switching cycles relay	Read only	0	999999	1	0	Info		
200	Burner control								
224	Specified time air pressure switch	Edit	0 s	13.818 s	0.294 s	13.18 s	SO	OEM	
225	Prepurge time -2.1 seconds	Edit	0 s	1237 s	4.851 s	29.106 s	SO	OEM	
226	Preignition time	Edit	1.029 s	37.485 s	0.147 s	2.058 s	SO	OEM	
230	Interval: End of safety time - load controller release	Edit	3.234 s	74.97 s	0.294 s	8.232 s	SO	OEM	
234	Postpurge time	Edit	0 s	1237 s	4.851 s	0	SO	OEM	
240	Repetition in the event of loss of flame during operation 0: None 1: None 2: 1 x repetition	Edit	0	2	1	0	so	OEM	
257	Postignition time -0.3 seconds	Edit	0 s	13.23 s	0.147 s	2.205 s	SO	OEM	

Parameter	meter Parameter			Value range			Password level		
number			Min.	Max.	Resolution	Factory setting	reading from level	Password level writing from level	
700	Error history								
701	Current error:	Read only					Service		
	00: Error code		2	255	1				
	01: Startup meter reading		0	999999	1				
	02: HMI phase								
	03: Power value		0%	100%	1				
702	Error history former 1:	Read only					Service		
	00: Error code		2	255	1				
	01: Startup meter reading		0	999999	1				
	02: HMI phase								
	03: Power value		0%	100%	1				
•									
•									
•									
711	Error history former 10:	Read only					Service		
	00: Error code		2	255	1				
	01: Startup meter reading		0	999999	1				
	02: HMI phase								
	03: Power value		0%	100%	1				
900	Process data								
936	Normalized speed	Read only	0%	100%	0,01%		Service		
951	Mains voltage	Read only	0 V	LME71.000A1: 175 V	1 V		Service		
				LME71.000A2: 350 V					
954	Flame intensity	Read only	0%	100%	1%		Service		

11 Error code list

Error code	•		
AZL2	7-segment	Clear text	Possible cause
Loc: 2	Loc 2	No establishment of flame at the end of safety time	Faulty or soiled fuel valvesFaulty or soiled flame detectorPoor adjustment of burner, no fuelFaulty ignition equipment
Loc: 3	Loc 3	Air pressure faulty (air pressure switch welded in no-load position, decrease to specified time (air pressure switch flame-on response time)	Air pressure switch faulty - Loss of air pressure signal after specified time - Air pressure switch has welded in no-load position
Loc: 4	Loc 4	Extraneous light	Extraneous light during burner startup
Loc: 5	Loc 5	Air pressure faulty, air pressure switch welded in working position	Time supervision air pressure switch - Air pressure switch has welded in working position
Loc: 7	Loc 7	Loss of flame	Too many losses of flame during operation (limitation of repetitions) - Faulty or soiled fuel valves - Faulty or soiled flame detector - Poor adjustment of burner
Loc: 8	Loc 8	Free	Loc: 8
Loc: 9	Loc 9	Free	Loc: 9
Loc: 10	Loc 10	Error not relatable (application), internal error	Wiring error or internal error, output contacts, other faults
Loc: 14	Loc 14	POC error	Error valve closure control POC
Loc: 22	Loc 22	Safety loop open	Gas pressure switch-max openSafety limit thermostat cut out
Loc: 138	Loc 138	Restore process successful	Restore process successful
Loc: 139	Loc 139	No program module detected	No program module plugged in
Loc: 167	Loc 167	Manual locking	Manual locking
Loc: 206	Loc 206	AZL2 incompatible	Use the latest version
rSt Er1	rSt Er1	Error in compatibility program module to basic unit during restore process	- Program sequence of program module does not match the basic unit
rSt Er2	rSt Er2	Error in compatibility program module to basic unit during restore process	- Hardware of basic unit does not match the program module
rSt Er3	rSt Er3	Error during restore process	Program module faultyProgram module removed during restore process
bAC Er3	bAC Er3	Fault of compatibility program module to basic unit during backup process	Program sequence of program module does not match the basic unit
Err PrC	Err PrC	Fault of program module	- Error in data content of program module - No program module fitted

12 Legend

AL	Alarm device
i/reset (EK1)	Lockout reset button (info button)
EK2	Remote lockout reset button
FSV	Flame signal amplifier
ION	Ionization probe
K	Relay contact
LED	3-color signal lamp
LP	Air pressure switch
LR	Load controller
LR-OPEN	Load controller OPEN position
LR-CLOSED	Load controller CLOSED position
M	Fan motor
NT	Power supply unit
Pmax	Pressure switch-max
Pmin	Pressure switch-min
POC	Valve closure control (proof of closure)
QRA	Flame sensor
R	Control thermostat or pressurestat
SK	Safety Loop
SV	Safety valve
V1	Fuel valve
V2a	Fuel valve
Z	Ignition transformer
	Input/output signal 1 (ON)
	Input/output signal 2 (OFF)
	Permissible input signal 1 (ON) or 0 (OFF)

13 List of figures

Figure 1: Program sequence	5
Figure 2: Fuel train gas direct ignition (G), 1-stage	7
Figure 3: Fuel train gas direct ignition (G), 2-stage	7
Figure 4: Inputs and outputs / internal connection diagram	9

Siemens AG Infrastructure & Cities Sector Building Technologies Division Berliner Ring 23 D-76437 Rastatt Tel. +49 7222 598 279 Fax +49 7222 598 269 © 2012 Siemens AG Infrastructure & Cities Sector Building Technologies Division Subject to change!

www.siemens.com