

Filter module VMF, Measuring orifice VMO, Fine-adjusting valve VMV

OPERATING INSTRUCTIONS

· Edition 01.20 · 03250879 · EN



CONTENTS

Safety	1
Changes to edition 11.18	1
Checking the usage	2
Installation	2
Tightness test	3
Commissioning	4
Maintenance	4
Accessories	5
Technical data	7
Designed lifetime	8
Logistics	8
Certification	9

SAFETY

Please read and keep in a safe place



Please read through these instructions carefully before installing or operating. Following the installation, pass the instructions on to the operator. This unit must be installed and commissioned in accordance with the regulations and standards in force. These instructions can also be found at www.docuthek.com.

Explanation of symbols

1, 2, 3, a, b, c = Action

→ = Instruction

Liability

We will not be held liable for damage resulting from non-observance of the instructions and non-compliant use.

Safety instructions

Information that is relevant for safety is indicated in the instructions as follows:

⚠ DANGER

Indicates potentially fatal situations.

⚠ WARNING

Indicates possible danger to life and limb.

⚠ CAUTION

Indicates possible material damage.

All interventions may only be carried out by qualified gas technicians. Electrical interventions may only be carried out by qualified electricians.

Conversion, spare parts

All technical changes are prohibited. Only use OEM spare parts.

CHANGES TO EDITION 11.18

The following chapters have been changed:

- Checking the usage
- Installation
- Commissioning
- Certification

CHECKING THE USAGE

Intended use

valVario filter module VMF, measuring orifice VMO and fine-adjusting valve VMV for installation in gas control and safety systems in the fields of industrial and commercial gas heat generation.

VMF

with replaceable filter pad insert to protect against soiling of downstream appliances.

VMO

with replaceable orifice insert. For use as a restricting or measuring orifice.

VMV

Fine-adjusting valve for presetting the gas or air flow rate to gas burners or gas appliances.

This function is only guaranteed when used within the specified limits – see page 7 (Technical data). Any other use is considered as non-compliant.

Type code

VMF	Filter module
1-3	Sizes
-	Without flange
10-65	Inlet and outlet flange nominal size
R	Rp internal thread
N	NPT internal thread
F	Flange to ISO 7005
05	p_u max. 500 mbar
P	Screw plugs
M	Test nipple


Type code

VMO	Measuring orifice
1-3	Sizes
10-65	Inlet and outlet flange nominal size
R	Rp internal thread
N	NPT internal thread
F	Flange to ISO 7005
05	p_u max. 500 mbar
M	Test nipple
04-54	Orifice diameter in mm

Type code

VMV	Fine-adjusting valve
1-3	Sizes
10-65	Inlet and outlet flange nominal size
R	Rp internal thread
N	NPT internal thread
F	Flange to ISO 7005
05	p_u max. 500 mbar
P	Screw plugs
M	Test nipple


Part designations

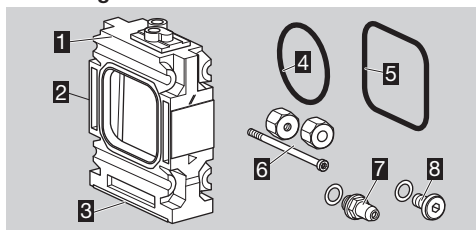

- 1 Housing
- 2 Type label
- 3 Base plate
- 4 O-ring
- 5 Double block seal
- 6 Connection parts (2 x)
- 7 Pressure test nipple
- 8 Sealing plug

Type label

Inlet pressure p_u and ambient temperature: see type label.

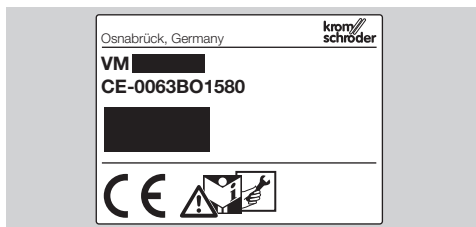

INSTALLATION


⚠ CAUTION

Incorrect installation


Please observe the following to ensure that the unit is not damaged during installation and operation:

- Dropping the device can cause permanent damage. In this event, replace the entire device and associated modules before use.
- Installation position: install the VMF with the base plate pointing downwards or sideways, otherwise dirt can collect in the housing when replacing the filter pad. The VMV can be installed as required; when fitting to pressure regulator VAD, VAG or VAV, the base plate must be facing the same direction as the regulator body. VMO can be installed as required.
- Installation position when using valVario controls: VMF is fitted upstream of the control, VMV is fitted downstream of the control. When used as a restrict-

ing orifice, the VMO is fitted downstream of the control.

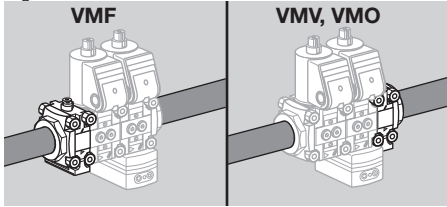

- Installation position with inlet and outlet flanges: VMF, VMV and VMO may be inserted at any position in the pipework. When used as a measuring orifice, the length of the inlet and outlet section of the VMO must be ≥ 5 DN.

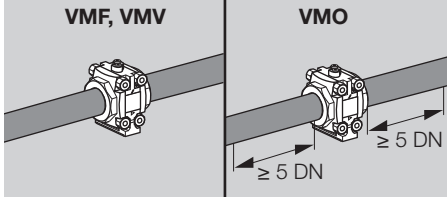


- The housing must not be in contact with masonry, minimum clearance 20 mm (0.79").
- Sealing material and thread cuttings must not be allowed to get into the housing.
- A filter must be installed upstream of every system.
- Ensure that there is sufficient space for installation and adjustment.
- Do not store or install the unit in the open air.

CAUTION

Incorrect installation

Please observe the following to ensure that the unit is not damaged during installation and operation:

- Only secure the device by holding the octagon on the flange with a suitable spanner. Risk of external leakage.

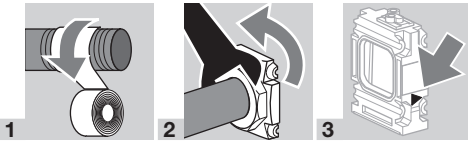


- Both O-rings or the O-ring and double block seal must be fitted.

WARNING

Risk of leakage.


Please note the following:

- If VMF, VMO or VMV has been delivered with two flanges and is subsequently attached to a valVario control, a double block seal must be used instead of the O-ring. The double block seal must be ordered separately, see accessories, seal set for sizes 1–3.

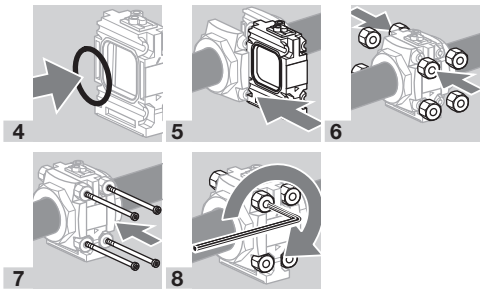


VMV

- If the fine-adjusting valve VMV is fitted downstream of a pressure regulator VAD, VAG or VAV, a differential pressure orifice with rubber seals **G** must be inserted at the outlet of the pressure regulator.

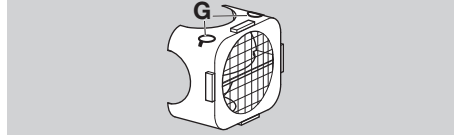


TIGHTNESS TEST


- 1 To be able to check the tightness, shut off the downstream pipeline close to the VMF, VMO, VMV.

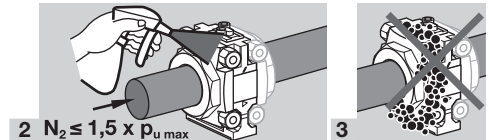

$$2 \quad N_2 \leq 1,5 \times p_{u \max}$$

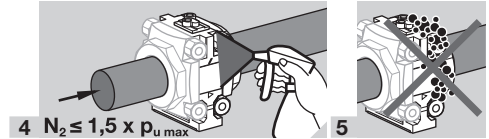

$$4 \quad N_2 \leq 1,5 \times p_{u \max}$$

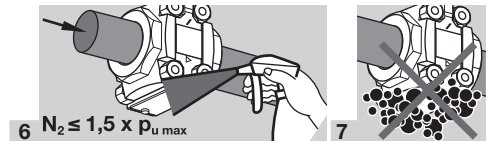

$$6 \quad N_2 \leq 1,5 \times p_{u \max}$$

- 8 Tightness OK: open the pipeline.


- Pipeline leaking: check O-rings. When installing on a valVario valve or pressure regulator, check the O-ring and, if fitted, the double block seal.
- Unit leaking: dismantle the VMF, VMO or VMV and return it to the manufacturer.

COMMISSIONING

VMV

Setting the flow rate

→ At the factory, the fine-adjusting valve VMV is adjusted for maximum flow rate (100%).

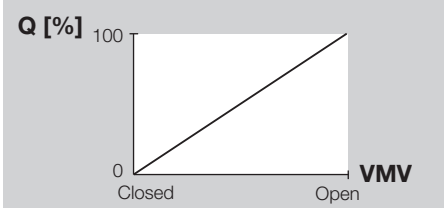

CAUTION


Please observe the following to ensure that the unit is not damaged during operation:

- Do not overturn the adjusting screw, as the fine-adjusting valve then can no longer be adjusted.

→ The VMV can be adjusted from two sides.

→ 2.5 mm Allen key.

1 Set the required flow rate.

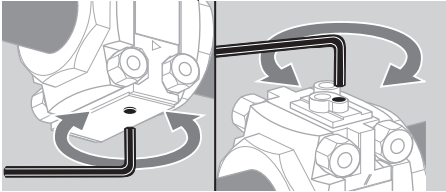

2 Check the VMV for tightness – see page 3 (Tightness test).


VMO

Replacing the orifice plate


→ Orifice plates – see accessories.

→ Flow rate diagrams – see page 7 (Technical data).

→ 2.5 mm Allen key.

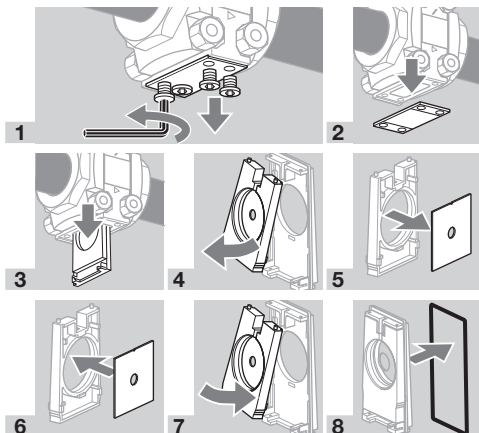

9 Insert the new sealing ring (included in the delivery) when fitting the new orifice plate. The sealing ring may be greased lightly, e.g. with Klüber Nontrop ZB91.

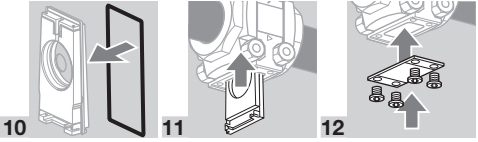

13 Screw the cover into place.

14 Check the VMO for tightness – see page 3 (Tightness test).

MAINTENANCE

CAUTION

In order to ensure smooth operation:

- Check the VM for tightness annually, or every six months if operated with biogas.

VMF: replacing the filter pad


→ If the flow rate is correct, check for tightness – see page 3 (Tightness test).

→ If the flow rate has dropped, replace the filter pad.

1 Disconnect the system from the electrical power supply.

2 Shut off the gas supply.

→ 2.5 mm Allen key.

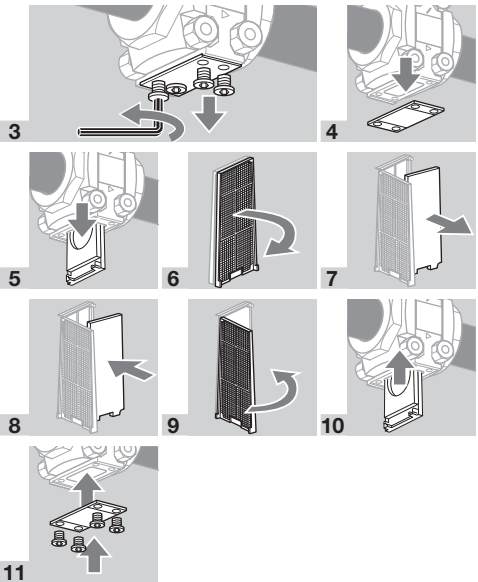


12 Screw the cover into place.

13 Check the VMF for tightness – see page 3 (Tightness test).

ACCESSORIES

Orifice plate


Orifice insert for installing in the plate bracket of measuring orifice VMO. The hole diameter is engraved on the orifice insert. Supply including the new seal for the base plate.




Orifice	Hole dia. [mm]	Order No.
VMO1 D4 /B	4	74923803
VMO1 D5 /B	5	74923804
VMO1 D6 /B	6	74923805
VMO1 D8 /B	8	74923806
VMO1 D10 /B	10	74923807
VMO1 D12 /B	12	74923808
VMO1 D14 /B	14	74923809
VMO1 D16 /B	16	74923810
VMO1 D18 /D	18	74923811
VMO1 D20 /B	20	74923812
VMO1 Dx /B*	xx*	74923813
VMO2 D16 /B	16	74923814
VMO2 D20 /B	20	74923815
VMO2 D24 /B	24	74923816
VMO2 D28 /B	28	74923817
VMO2 D32 /B	32	74923818
VMO2 D34 /B	34	74923819
VMO2 D38 /B	38	74923820
VMO2 Dx /B	xx*	74923821
VMO3 D38 /B	38	74926017
VMO3 D42 /B	42	74926018
VMO3 D46 /B	46	74926019
VMO3 D50 /B	50	74926020
VMO3 D54 /B	54	74926021
VMO3 Dx /B	xx*	74926022

* Hole diameter on request.


VMO 110/115






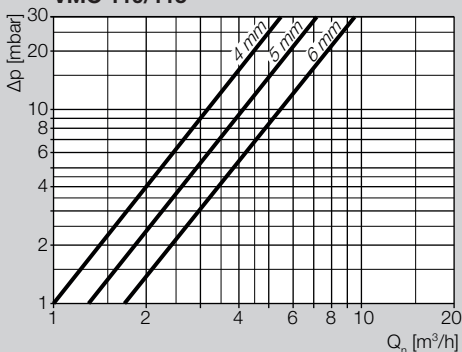


VMO 120

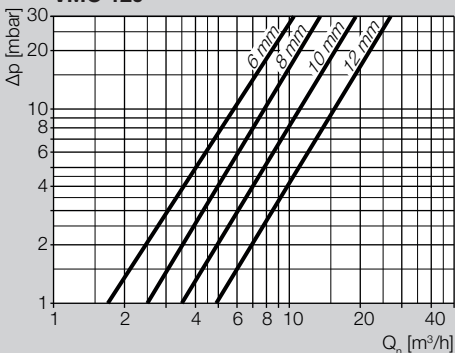


VMO 125

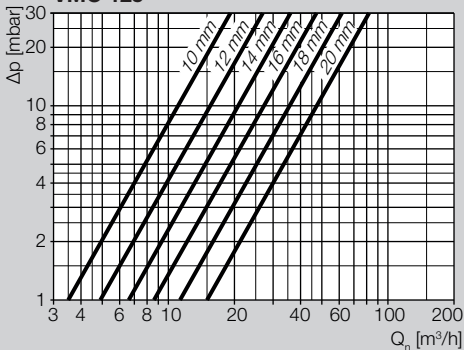

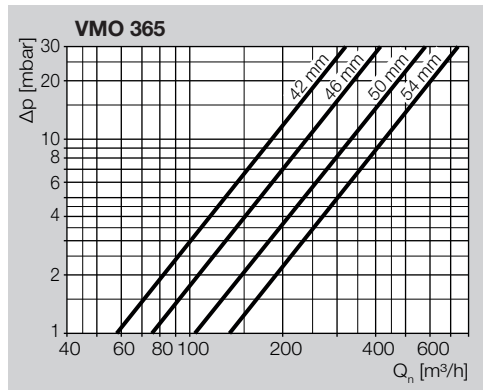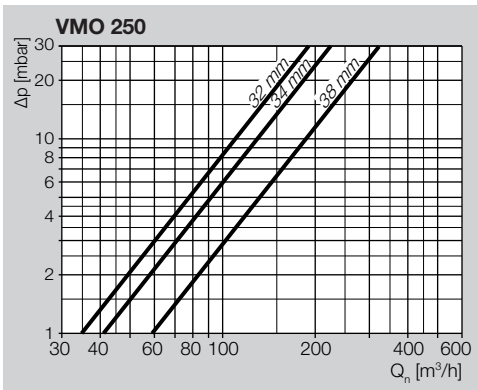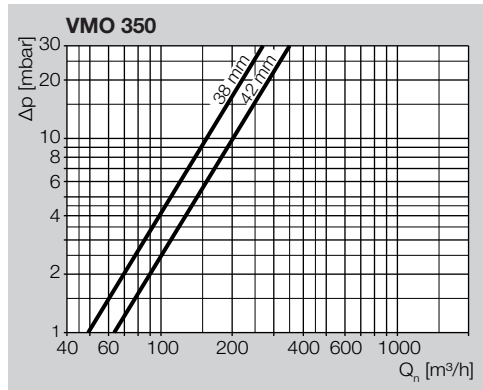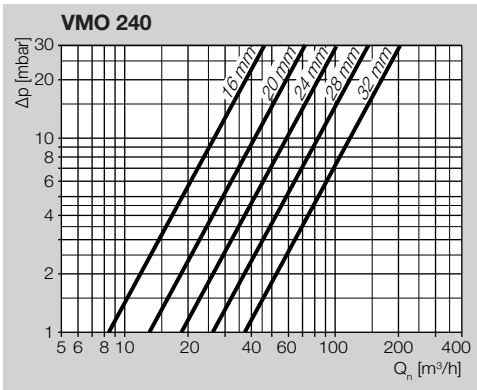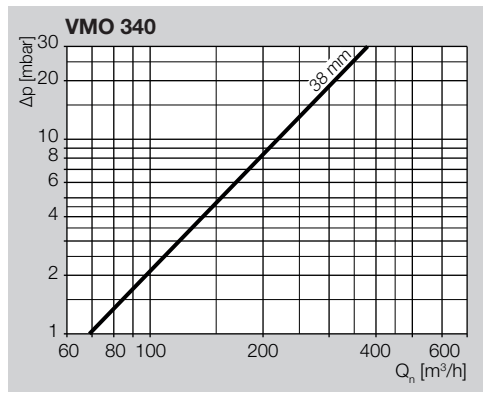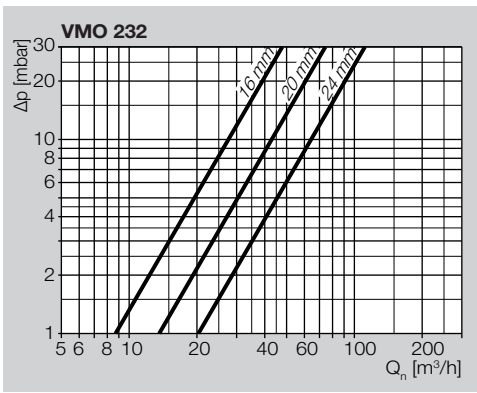

Seal set for sizes 1-3

When retrofitting accessories or a second valVario control or when servicing, we recommend replacing the seals.

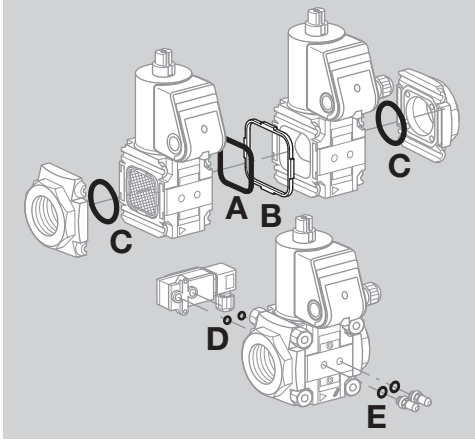

VAS 1-3

VA 1, Order No. 74921988,
VA 2, Order No. 74921989,
VA 3, Order No. 74921990.

Scope of delivery:

- A** 1 x double block seal,
- B** 1 x retaining frame,
- C** 2 x O-rings (flange),
- D** 2 x O-rings (pressure switch),

for test nipple/screw plug:

- E** 2 x sealing rings (flat sealing),
- 2 x profiled sealing rings.


VCS 1-3

VA 1, Order No. 74924978,
VA 2, Order No. 74924979,
VA 3, Order No. 74924980.

Scope of delivery:

- A** 1 x double block seal,
- B** 1 x retaining frame.

Seal set VMO/VMV

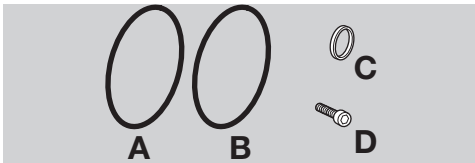


Seal set VMO/VMV 1 /B: 74924936
Seal set VMO/VMV 2 /B: 74924937
Seal set VMO/VMV 3 /B: 74926024

Scope of delivery:

- A** 1 x O-ring (base plate)
- B** 1 x O-ring (restrictor insert)
- C** 2 x profiled sealing rings
- D** 2 x or 4 x set screws

Filter pad set

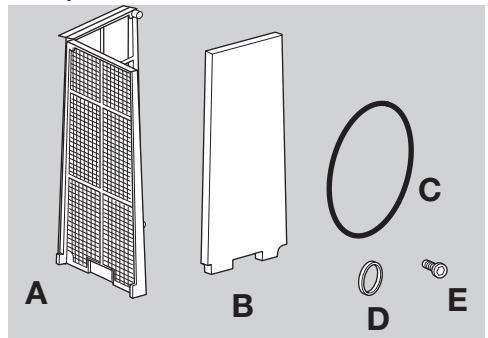

Filter pad set for size 1: Order No. 74923800
Filter pad set for size 2: Order No. 74923801,
Filter pad set for size 3: Order No. 74926023
Scope of delivery:

VMF 1-2:

- A** 1 x filter frame
- B** 10 x filter pads
- C** 10 x seals for the base plate
- D** 2 x profiled sealing rings for 1/8" test nipple
- E** 2 x screws for securing the base plate

VMF 3:

- A** 1 x filter frame
- B** 10 x filter pads
- C** 10 x 61x2 O-rings
- D** 2 x profiled sealing rings for 1/8" test nipple
- E** 4 x screws for securing the base plate

TECHNICAL DATA

Gas types:

natural gas, LPG (gaseous), biogas (max. 0.1 %-by-vol. H₂S) or air; other gases on request.

The gas must be dry in all conditions and must not contain condensate.

Max. inlet pressure p_{U} :
500 mbar (7.25 psig).

Medium and ambient temperatures:

-20 to +60°C (-4 to +140°F), no condensation permitted.

Long-term use in the upper ambient temperature range accelerates the ageing of the elastomer materials and reduces the service life (please contact manufacturer).

Storage temperature: -20 to +40°C (-4 to +104°F).


Housing: aluminium.

Connection flanges:

with internal thread: Rp to ISO 7-1, NPT to ANSI/ASME,


with ISO flange: DN 40 and DN 50 to ISO 7005.

VMV: air flow rate Q for a pressure loss of $\Delta p = 1$ mbar:



	$Q_{\min.}$ [m ³ /h]	$Q_{\max.}$ [m ³ /h]
VMV 110	0.2	9.1
VMV 115	0.2	12.5
VMV 120, VMV 125	0.2	19.4
VMV 225	0.6	36.1
VMV 232–VMV 250	0.6	51.4
VMV 340	0.3	68
VMV 350	0.3	60.1
VMV 365	0.3	64.8

VMV: air flow rate Q for a pressure loss of $\Delta p = 10$ mbar:



	$Q_{\min.}$ [m ³ /h]	$Q_{\max.}$ [m ³ /h]
VMV 110	0.4	22.9
VMV 115	0.4	31.4
VMV 120, VMV 125	0.4	48.8
VMV 225	1.5	91
VMV 232–VMV 250	1.5	129.6
VMV 340	0.3	68
VMV 350	0.3	60.1
VMV 365	0.3	64.8

VMF: air flow rate Q for pressure loss Δp :

	Air flow rate Q [m ³ /h] for	
	$\Delta p = 1$ mbar	$\Delta p = 10$ mbar
VMF 110	4.9	15.5
VMF 115	7	22.1
VMF 120	13	41.2
VMF 125	16	50.7
VMF 225	23.2	73.5
VMF 232	31.9	101
VMF 240	38.3	121
VMF 250	41.1	130
VMF 340	61	194
VMF 350	64	203
VMF 365	68	218

DESIGNED LIFETIME

This information on the designed lifetime is based on using the product in accordance with these operating instructions. Once the designed lifetime has been reached, safety-relevant products must be replaced. Designed lifetime (based on date of manufacture) in accordance with EN 13611, EN 161 for VM 1 to VM 2: 10 years.

You can find further explanations in the applicable rules and regulations and on the afecor website (www.afecor.org).

This procedure applies to heating systems. For thermoprocessing equipment, observe local regulations.

LOGISTICS

Transport

Protect the unit from external forces (blows, shocks, vibration).

Transport temperature: see page 7 (Technical data).

Transport is subject to the ambient conditions described.

Report any transport damage on the unit or packaging without delay.

Check that the delivery is complete.

Storage

Storage temperature: see page 7 (Technical data).

Storage is subject to the ambient conditions described.

Storage time: 6 months in the original packaging before using for the first time. If stored for longer than this, the overall service life will be reduced by the corresponding amount of extra storage time.

Packaging

The packaging material is to be disposed of in accordance with local regulations.

Disposal

Components are to be disposed of separately in accordance with local regulations.

CERTIFICATION

Declaration of conformity



We, the manufacturer, hereby declare that the products VAS.../VAD/VAG/VAV/VAC/VAH/VBY/VRH/VMF/VMV/VMO with product ID No. CE-0063BO1580 comply with the requirements of the listed Directives and Standards.

Directives:

- 2014/35/EU – LVD
- 2014/30/EU – EMC
- 2011/65/EU – RoHS II
- 2015/863/EU – RoHS III

Regulation:

- (EU) 2016/426 – GAR

Standards:

- EN 161:2011+A3:2013
- EN 88-1:2011+A1:2016
- EN 126:2012
- EN 1854:2010

The relevant product corresponds to the tested type sample.

The production is subject to the surveillance procedure pursuant to Regulation (EU) 2016/426 Annex III paragraph 3.

Elster GmbH

Scan of the Declaration of conformity (D, GB) – see www.docuthek.com

Eurasische Zollunion



The products VMV meet the technical specifications of the Eurasian Customs Union.

REACH Regulation

The device contains substances of very high concern which are listed in the Candidate List of the European REACH Regulation No. 1907/2006. See Reach list HTS at www.docuthek.com.

China RoHS

Directive on the restriction of the use of hazardous substances (RoHS) in China. Scan of the Disclosure Table China RoHS2, see certificates at www.docuthek.com.

FOR MORE INFORMATION

The Honeywell Thermal Solutions family of products includes Honeywell Combustion Safety, Eclipse, Exothermics, Hauck, Kromschöder and Maxon. To learn more about our products, visit www.ThermalSolutions.honeywell.com or contact your Honeywell Sales Engineer.
Elster GmbH
Strotheweg 1, D-49504 Lotte
T +49 541 1214-0
hts.lotte@honeywell.com
www.kromschroeder.com

Global centralized service deployment coordination:
T +49 541 1214-365 or -555
hts.service.germany@honeywell.com

Translation from the German
© 2020 Elster GmbH

Honeywell
krom
schroder