


**RoHS COMPLIANT**

REV.	DESCRIPTION	DATE
A		2021.11.13
A	Change the plug to the terminal frame type	2022.10.11

CUSTOMER: P/N: MD228 REV. APPROVED BY:

**NOTES:**

- The outer box must have the RoHS mark (RoHS shown on the carton)
- The tail WS-002 uses a transparent inner sleeve

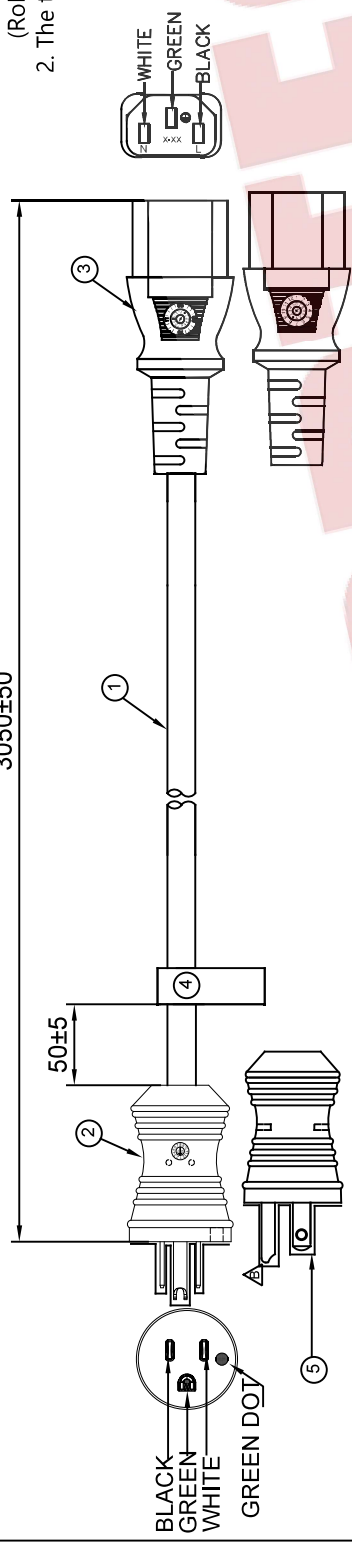


**MARKING:**

WELL SHIN®  
 (K) WS-002  
 15A 125V~  
 E115330

IEC-60320-C13  
 CLEAR


**MARKING:**



NEMA 5-15P  
 HOSPITAL GRADE  
 CLEAR



④ Hosp. Grade label

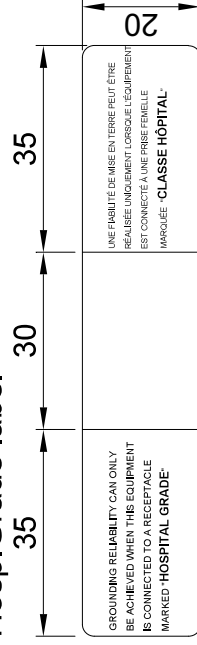

NO.	DESCRIPTION	COLOR	QTY
⑥	Cable tie	WHITE	1PCS
⑤	Protective case	WHITE	1PCS
④	Wire label 100mm*20mm	CLEAR	1PCS
③	WS-002 15A 125V APPROVAL: UL,CUL	CLEAR	1PCS
②	WS-001H(5-15P) 15(A) 125(V) APPROVAL: UL,CUL	CLEAR	1PCS
①	CULJUS E90165-K SJT 3x2.08mm²(14AWG) 105°C 300V VVW-1 WELL SHIN	GREY	1PCS

SIGNATURE
ENGINEER BY:
MANAGER BY:
CHECKED BY:
DRAWN BY:



**AC Connectors of Cordtec Power Corp**  
 Main: 1-414-434-2220 Fax: 1-414-323-8386  
 Text: 1-414-323-3240  
 Email: Info@CordtecPower.com  
 Website: CordtecPower.com/ ACWORKS.com