
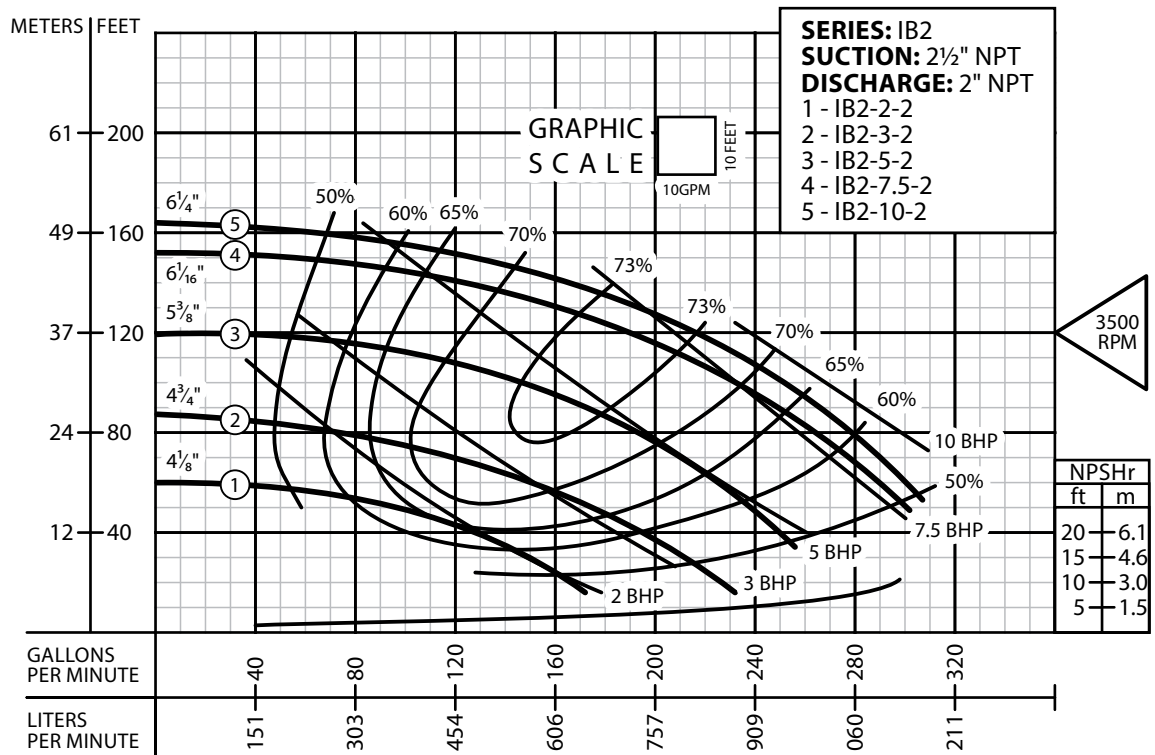


**PERFORMANCE CURVE End-Suction
Centrifugal Close Coupled
Series: IB2**

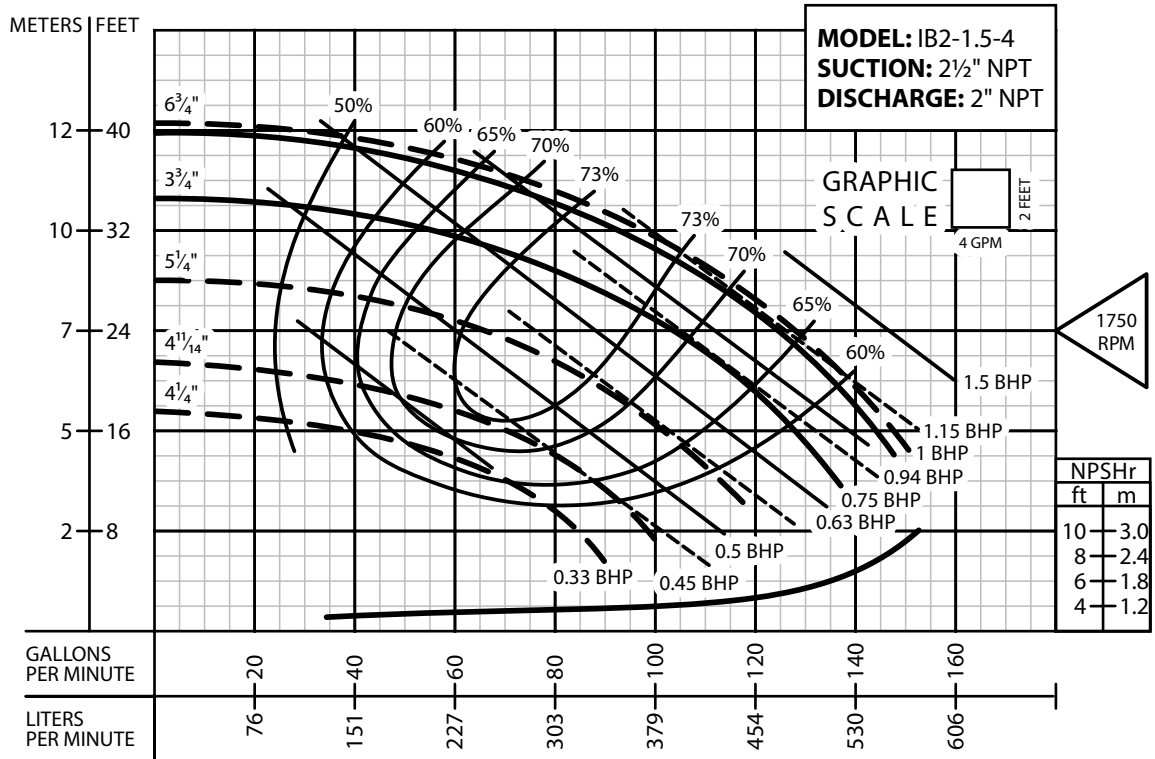

Testing is performed with water specific gravity of 1.0 @ 68 °F (20 °C); other fluids may vary performance.

Cooling Tower Systems, Inc.

3170 Mercer University Dr., Macon, GA 31204

TF: 800.752.1905

F: 478.755.8304

www.coolingtowersystems.com

info@coolingtowersystems.com