

Bellaterra: 26<sup>th</sup> of April, 2019  
File number: 19/19154-550  
Test petitioner:

## TEST REPORT

3<sup>rd</sup> of May, 2019. In case of dispute, the valid document is the original Spanish version.

**Requested test:** Laboratory measurement of the improvement of impact sound insulation, in accordance with the standards UNE-EN ISO 10140-3:2011, UNE-EN ISO 10140-3:2011/A1:2015 and UNE-EN ISO 10140-1:2016 (Annex H), by a floor covering composed of rubber tiles referenced ***rubber tiles***.

**Dates of test:** 19<sup>th</sup> of March, 2019

**Test carried out by:** Xavier Roviralta (Acoustics Laboratory - LGAI Technological Center)

**Applus+**  
laboratories



Firmado digitalmente  
por Xavier Roviralta

Xavier Roviralta  
Technical Manager of Acoustics  
LGAI Technological Center S.A. (APPLUS)

### Service Quality Assurance

**Applus+** guarantees that this work has been made in accordance with our Quality and Sustainability System, fulfilling the contractual conditions and legal norms. Within our improvement program we would be grateful if you would send us any commentary that you consider opportune, to the person in charge who signs this document, or to the Quality Manager of Applus+, in the following e-mail address: [satisfaccion.cliente@applus.com](mailto:satisfaccion.cliente@applus.com)

The reproduction of this document is only authorised if it is made in its totality. Electronically signed reports in digital format are considered original documents, as well as its electronic copies. Their printing has no legal validity.  
This document consists of 15 pages 1 of which are Annexes.

- Page 1 -

## 1.- SCOPE OF THE TEST

The scope of this test is to determinate the improvement of impact sound insulation, in accordance with the standards UNE-EN ISO 10140-3:2011, UNE-EN ISO 10140-3:2011/A1:2015 and UNE-EN ISO 10140-1:2016 (Annex H), by a floor covering composed of rubber tiles referenced **BEKA rubber tiles**.

## 2.- MEASUREMENT EQUIPMENT

The equipment used in the test is the following:

- Spectrum analyser id. number: 170701 (Bruel&Kjaer mod. Pulse LAN-XI)
- Microphone calibrator id. number: 103032 (Bruel&Kjaer mod. 4231)
- Diffuse field microphone id. number: 103131 (Bruel&Kjaer mod. 4943)
- Rotating microphone boom id. number: 170692 (Ntek mod. MB-01)
- Standard tapping machine id. number: 103187 (CESVA mod. MI005) with casing id. number: 170642
- Sound source id. number: 103098 (AVM mod. DO12)
- Noise generator with power amplifier id. number: 103125 (CESVA mod. AP600)
- Equalizer id. number: 170092 (INTER mod. EQ-9231)
- Thermo-hygrometer and barometer id. number: 170680 (PCE mod. THB-40)
- Tape measurer id. number: 103095 (Stanley mod. Powerlock)
- Distance meter id. number: 170136 (Stanley mod. TLM130)
- Set of weights id. number: 170564 (12 weights are used)


## 3.- TEST PROCEDURE AND EVALUATION

### 3.1. TEST METHOD

The test is carried out in accordance with the standards UNE-EN ISO 10140-3:2011 "Measurement of impact sound insulation" together with its Modification 1 UNE-EN ISO 10140-3:2011/A1:2015 and UNE-EN ISO 10140-1:2011 Annex H "Floor coverings. Improvement of impact sound insulation", which are part of the set of standards UNE-EN ISO 10140 "Laboratory measurement of sound insulation of building elements".

The test procedure consists on measuring the impact sound insulation of a basic construction (reference floor) with or without the lining to be tested. Both measurements are carried out according to the standards UNE-EN ISO 10140-3:2011 and UNE-EN ISO 10140-3:2011/A1:2015.

Two vertically adjacent rooms are used; the upper being designated the 'source room' and the lower the 'receiving room'. The test element is mounted in the opening between those rooms. The test procedure is based on measuring for every frequency band within the range of study, customarily from 100 Hz to 5000 Hz, the sound pressure level in the 'receiving room' when exciting the upper floor with a standardized tapping machine placed in at least four different positions. The equivalent absorption area in the receiving room is calculated from the reverberation time measurements.

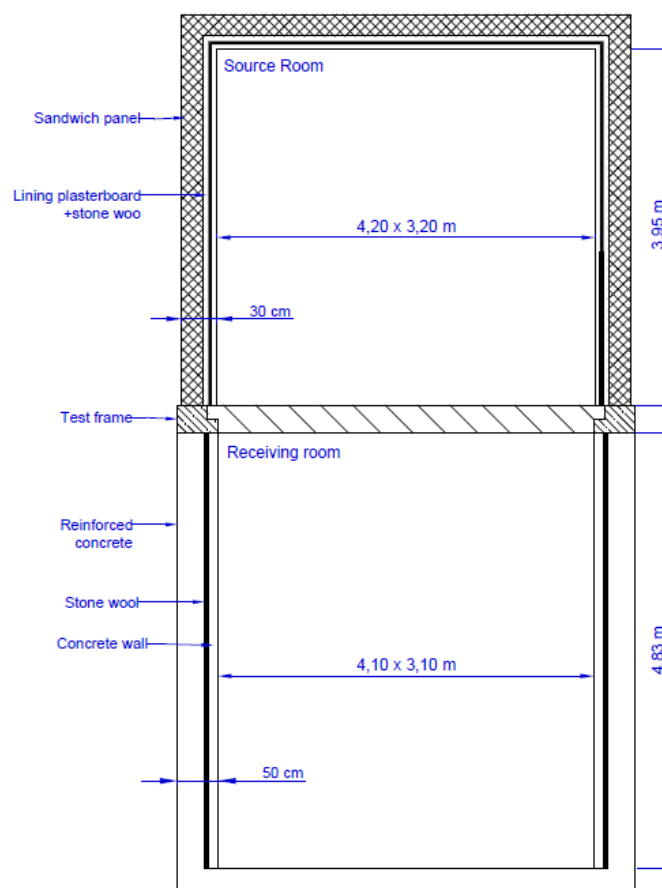

**Schematic drawing of the test rooms**

Sound pressure level and reverberation time measurements are carried out according to the standard UNE-EN ISO 10140-4:2011.

The background noise level shall be at least 6 dB (and preferably more than 15 dB) below the level of signal and background noise combined at each frequency band. If the measured sound pressure level does not fulfil this condition, the corrections indicated in section 4.3 of the standard UNE-EN ISO 10140-4:2011 shall be applied.

At each frequency band, the **normalized sound pressure level**,  $L_n$ , is calculated increasing the impact sound pressure level,  $L_i$ , by a correction term which depends on the reverberation time and the receiving room volume:

$$L_n = L_i + 10 \text{ Log} \left( \frac{A}{A_0} \right) \text{ [dB]}$$

where:

- $L_i$  is the impact sound pressure level, corrected by the background noise if necessary, at each frequency band;
- $A_0$  is the reference equivalent absorption area, 10 m<sup>2</sup>;
- $A$  is the measured equivalent absorption area of the receiving room, defined in the UNE-EN ISO 10140-4:2011, and calculated by:

$$A = \frac{0.16 V}{T} \text{ [m}^2\text{]}$$

where:

- $V$  is the receiving room volume, in m<sup>3</sup>;
- $T$  is the reverberation time in the receiving room, in seconds. It is defined as the time required for the sound pressure level in a room to decrease by 60 dB after the sound source has stopped.

### 3.2. IMPROVEMENT OF IMPACT SOUND INSULATION

The standard UNE-EN ISO 10140-1:2011 "Application rules for specific products" specifies, in Annex H "Floor coverings. Improvement of impact sound insulation" the procedure to measure the improvement of impact sound insulation of floor coverings intended to improve the impact sound insulation of floors.

The quantity determined is the **improvement of impact sound insulation,  $\Delta L$** , in decibels, defined as the reduction in normalized impact sound pressure level resulting from the installation of the test floor covering on the reference floor:

$$\Delta L = L_{n0} - L_n \text{ [dB]}$$

where:

- $L_{n0}$  is the normalized impact sound pressure level of the reference floor without the floor covering;
- $L_n$  is the normalized impact sound pressure level of the reference floor with the floor covering.

The standard reference floors are defined in the standard UNE EN-ISO 10140-5:2011 Annex C; one heavyweight reference floor and three lightweight reference floors. Commonly the heavyweight reference floor is the floor used, which consist of a reinforced concrete slab of thickness  $120^{+40}_{-20}$  mm, preferably 140 mm for the construction of new laboratories. It should be homogeneous and shall be of uniform thickness.

### 3.3. PROCEDURE FOR EVALUATING SINGLE-NUMBER QUANTITIES FOR IMPACT SOUND INSULATION RATING

The method of measurement gives values for the impact sound insulation which are frequency dependent. The standard ISO 717-2 normalizes a method whereby the frequency-dependent values of impact sound insulation can be converted into a single number characterizing the acoustical performance.

From the curve of impact sound it is possible to obtain the global weighted value comparing that curve with the reference spectrum (given in table 3.1) defined between 100 and 3150 Hz:

Freq. (Hz)	100	125	160	200	250	315
Ref.	62	62	62	62	62	62
Freq. (Hz)	400	500	630	800	1000	1250
Ref.	61	60	59	58	57	54
Freq. (Hz)	1600	2000	2500	3150	4000	5000
Ref.	51	48	45	42	-	-

**Table 3.1: Reference values for impact sound for every frequency band**

The global weighted value is the value, in decibels, of the reference curve at 500 Hz after shifting it in accordance with the following procedure.

To evaluate the results of a measurement ( $L_n$ , for example), the reference spectrum is shifted in increments of 1 dB towards the measured curve until the sum of unfavourable deviations is as large as possible but not more than 32,0 dB. An unfavourable deviation at a particular frequency occurs when the results of measurements exceed the reference value for that frequency band.

By the appliance of this evaluation to the normalized impact sound pressure level,  $L_n$ , the **weighted normalized impact sound pressure level,  $L_{nw}$** , is obtained.

### 3.4. PROCEDURE FOR EVALUATING THE WEIGHTED REDUCTION IN IMPACT SOUND PRESSURE LEVEL, $\Delta L_w$

To calculate the **weighted reduction in impact sound pressure level,  $\Delta L_w$** , it is necessary to relate the measured  $\Delta L$  levels with a reference floor. The reference floor is defined by the values for the normalized impact sound pressure level,  $L_{n,r,0}$ , given in table 3.2:

Freq. (Hz)	100	125	160	200	250	315
Ref.	67	67,5	68	68,5	69	69,5
Freq. (Hz)	400	500	630	800	1000	1250
Ref.	70	70,5	71	71,5	72	72
Freq. (Hz)	1600	2000	2500	3150	4000	5000
Ref.	72	72	72	72	-	-

**Table 3.2: One-third octave band values of the reference curve**

The weighted normalized impact sound pressure level of the reference floor,  $L_{n,r,0,w}$ , is 78 dB.

The weighted reduction of impact sound pressure level,  $\Delta L_w$ , is calculated according to the following equations:

$$L_{n,r} = L_{n,r,0} - \Delta L \quad [\text{dB}]$$

$$\Delta L_w = L_{n,r,0,w} - L_{n,r,w} = 78 \text{ dB} - L_{n,r,w}$$

where:

- $L_{n,r}$  is the calculated normalized impact sound pressure level of the reference floor with the floor covering under test;

- $L_{n,r,0}$  is the defined normalized impact sound pressure level of the reference floor (see Table 3.2);
- $\Delta L$  is the reduction in impact sound pressure level measured in accordance with the standard UNE-EN ISO 10140-1:2016;
- $L_{n,r,w}$  is the calculated weighted normalized impact sound pressure level of the reference floor with the floor covering under test;
- $L_{n,r,0,w}$  is obtained in accordance with section 4.3.1 of the standard ISO 717-2 (see section 3.3).

The reduction in impact sound pressure level measured on a concrete floor slab as defined in the Annex H of the standard UNE-EN ISO 10140-1:2011 and the single-number quantity  $\Delta L_w$  may only be used in connection with similar types of massive floors (concrete, hollow concrete, hollow bricks and similar); it is not appropriate for use on other types of construction.

### 3.5. CALCULATION OF THE SPECTRUM ADAPTATION TERMS

The rating by  $L_{n,w}$  has been shown to be quite adequate in characterizing impact noise like walking for wooden floors and concrete floors with effective coverings such as carpets or floating floors. However, it insufficiently takes into account level peaks at single (low) frequencies, for instance with timber joist floors, or the behaviour of bare concrete floors in this respect. There is clear evidence that the unweighted impact level of the tapping machine is more representative of the A-weighted impact levels as caused by walking for all types of floor, while this rating is also more restrictive to single noise peaks.

Therefore an adaptation term  $C_1$  is introduced to take this effect into account, given as a separate number which cannot be confused with the value for  $L_{n,w}$ . This term is so defined that for massive floors with effective coverings its value is about zero, while for timber joist floors with dominating low frequency peaks it will be slightly positive. For concrete floors without cover or with less effective covering, it will range from -15 to 0 dB.

If these effects are to be taken into account in requirements, these could be written as the sum of  $L_{n,w}$  and  $C_1$ .

The results of a measurement of  $L_n$  in one-third-octave bands in the frequency range 100 Hz to 2500 Hz are added up on an energetic basis resulting the  $L_{n,sum}$ . The spectrum adaptation term  $C_I$  is calculated from the following equation:

$$C_I = L_{n,sum} - 15 - L_{n,w} \quad [\text{dB}]$$

The spectrum adaptation term is calculated with decimal precision and rounded to an integer afterwards.

A spectrum adaptation term for flat response for the impact sound reduction may be determined and stated. This spectrum adaptation term  $C_{I\Delta}$  is calculated from:

$$C_{I\Delta} = C_{I,r,0} - C_{I,r} \quad [\text{dB}]$$

where:

- $C_{I,r}$  is the spectrum adaptation term for the reference floor with the floor covering under test;
- $C_{I,r,0}$  is the spectrum adaptation term for the reference floor with  $L_{n,r,0}$  ( $C_{I,r,0} = -11$  dB).

### 3.6. UNCERTAINTY OF RESULTS

The uncertainty associated to the test has been calculated and is available to the petitioner. The expanded uncertainty has been calculated as the typical measurement uncertainty multiplied by a coverage factor  $k=2$ , which for a normal distribution corresponds to a coverage probability of approximately 95%.

## 4.- REFERENCE FLOOR AND STANDARD TAPPING MACHINE DESCRIPTIONS

The basic element is a heavyweight reference floor in accordance with the requirements in the Annex C of the standard UNE-EN ISO 10140-5:2011. It is a reinforced concrete slab of thickness 140 mm, homogeneous and of uniform thickness.

The tapping machine is a standard tapping machine that fulfils the requirements of the standard UNE-EN ISO 10140-5:2011 Annex E.



## 5.- TEST ELEMENT DESCRIPTION

The main characteristics of the test element are listed below (commercial references are provided by the client). LGAI Technological Center, S.A. is not responsible for the documentation and/or information provided for the petitioner.

<b>Type of test element</b>	Floor covering
<b>Manufacturer</b>	BEKA SPORT Zeminleri Ins. Mad. Koz. San. ve Dis Tic. LTD. STI.
<b>Model / Reference</b>	<b><i>BEKA rubber tiles</i></b>
<b>Supplied by</b>	BEKA SPORT Zeminleri Ins. Mad. Koz. San. ve Dis Tic. LTD. STI.
<b>Date received</b>	7 <sup>th</sup> of March, 2019
<b>Area, <i>S</i>, of test element (test opening)</b>	12,71 m <sup>2</sup> – 4,10 x 3,10 m
<b>Test element thickness</b>	160 mm (reference floor: 140 mm; floor covering: 20 mm)
<b>Mass per unit area, <i>m</i> (estimated)</b>	≈368 kg/m <sup>2</sup> (reference floor: ≈350 kg/m <sup>2</sup> ; floor covering: 18 kg/m <sup>2</sup> )
<b>Type of mounting</b>	In the opening of a concrete frame (test frame)
<b>Composition</b>	<ul style="list-style-type: none"> <li>- Reference floor: Heavyweight reference floor, heavyweight standard floor in accordance with the Annex C of standard EN ISO 10140-5. Reinforced concrete slab of thickness 140 mm</li> <li>- Floor covering 4,4x3,4 m composed of (from bottom to top): <ul style="list-style-type: none"> <li>- Tiles made of EPDM and recycled SBR Rubber with MDI polyurethane adhesive of nominal dimensions 1000x1000 mm and 20 mm of thickness. Nominal density material of 970 kg/m<sup>3</sup> (provided by the test petitioner) and 18 kg/m<sup>2</sup> of mass per unit area.</li> </ul> </li> </ul>
<b>Test element sealing</b>	High density mastic
<b>Test arrangement</b>	In accordance with the specifications in Section 6 of UNE-EN-ISO 10140-3:2011 and Annex H of the UNE-EN-ISO 10140-1:2011
<b>Type of floor covering</b>	Category II, according to Annex H of the EN ISO 10140-1
<b>Test element assembling (carried out by/date)</b>	Applus Laboratories - LGAI Technological Center /18 <sup>th</sup> of March, 2019
<b>Mounting type</b>	See figures 1 and 2

The technical information of the test element, provided by the test petitioner, is attached in the Annex.

In order to determinate the improvement of impact sound insulation provided by the floor covering two measurements are carried out: the measurement of the standard reference floor without the floor covering (22/02/2019) and the measurement of the standard reference floor with the floor covering (19/03/2019).



**Images 1 to 4 Details of *BEKA* rubber tiles**






**Images 5 to 12 Installation and sealing of the floor covering on the reference floor**



**Images 13 Test specimen installed and ready for the test**

The following figures show the sections of the tested constructions.

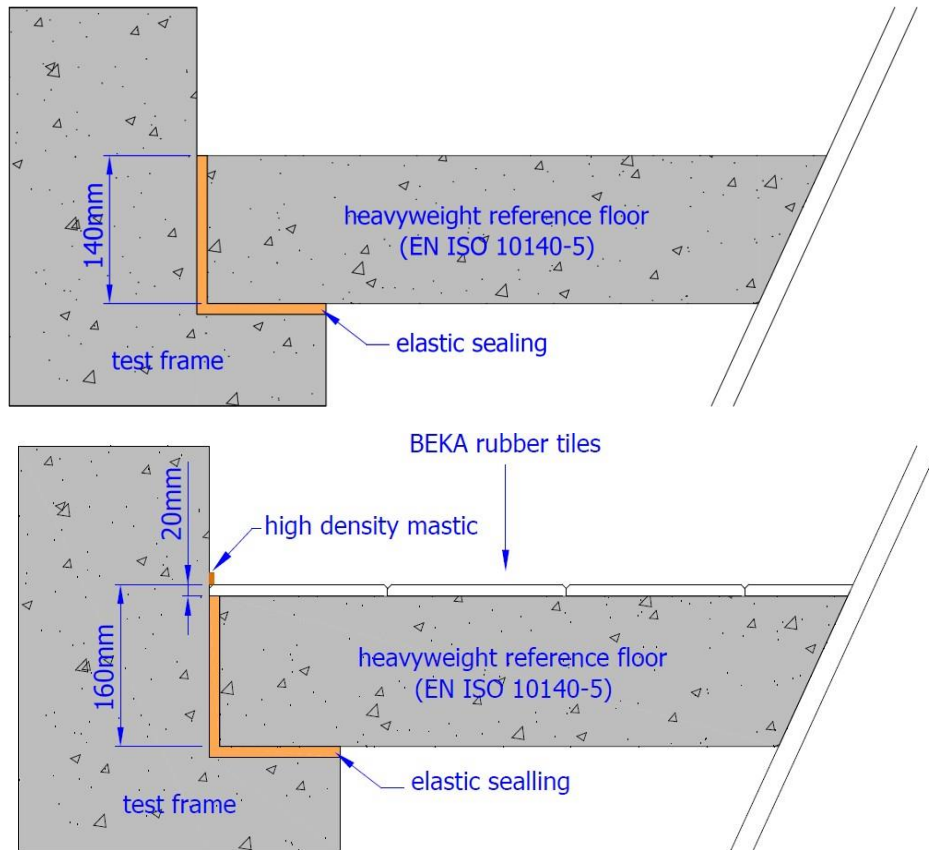

**Figures 1 and 2 Reference floor and reference floor with the floor covering**

## 6.- TEST CONDITIONS

6.1. STANDARD REFERENCE FLOOR (heavyweight reference floor in accordance with UNE-EN ISO 10140-5:2011 Annex C)

	Source Room	Receiving Room
<b>Room volumes</b>	52,9 m <sup>3</sup>	62,9 m <sup>3</sup>
<b>Climatic conditions</b>	Temperature: 20,8 ±0,6 °C	Temperature: 21,1 ±0,6 °C
	Humidity: 52,2 ±4,7 %	Humidity: 50,4 ±4,7 %
	Static pressure: 1012,6 ±1,3 hPa	

6.2. STANDARD REFERENCE FLOOR + FLOOR COVERING

	Source Room <sup>(Note 1)</sup>	Receiving Room
<b>Room volumes</b>	52,6 m <sup>3</sup>	62,9 m <sup>3</sup>
<b>Climatic conditions</b>	Temperature: 20,2 ±0,6 °C	Temperature: 19,9 ±0,6 °C
	Humidity: 61,3 ±4,7 %	Humidity: 60,1 ±4,7 %
	Static pressure: 1007,1 ±1,3 hPa	

Note 1: The floor covering (test element) is located into the source room.



## 7.- RESULTS



### Reduction of impact sound pressure level in accordance with the Standard ISO 10140 (all parts)

**Client:** BEKA SPORT Zeminleri Ins. Mad. Koz. San. ve Dis Tic. LTD. STI.

**Test element:**

Floor covering composed of rubber tiles referenced **BEKA rubber tiles**, installed on a heavyweight reference floor (standard reference floor in accordance with UNE-EN ISO 10140-5:2011 Annex C).

**Mass per unit area,  $m$ ,** estimated: 368 kg/m<sup>2</sup> (18 kg/m<sup>2</sup> floor covering)


**Area,  $S$  of the test element:** 12,71 m<sup>2</sup> (4,10 x 3,10 m)

**Dates of test:** 19/03/2019 (reference floor 22/02/2019)



Frequency (Hz)	$L_{n,0}$ (dB)	$\Delta L$ (dB)
100	56,5	4,6
125	59,3	2,8
160	70,2	8,6
200	71,4	9,6
250	75,2	12,8
315	75,0	20,3
400	76,2	24,1
500	77,0	27,5
630	76,0	28,8
800	76,0	32,3
1000	75,6	36,2
1250	75,4	39,7
1600	75,5	45,8
2000	75,0	52,8
2500	74,8	57,5
3150	74,8	56,1
4000	73,5	59,5
5000	71,9	53,3

Reduction of transmitted impact sound pressure level,  $\Delta L$

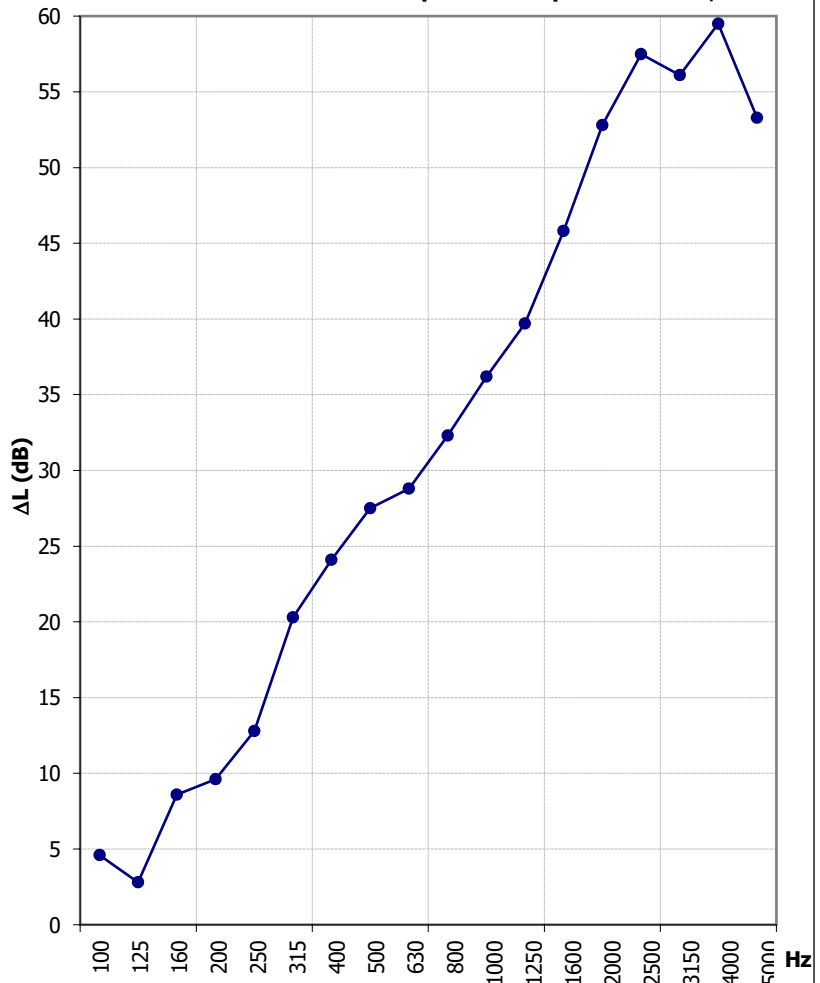

ISO 717-2	$L_{n,0,w} = 81$ dB	$L_{n,w} = 52$ dB	$L_{n,r,w} = 52$ dB	$\Delta L_w = 26$ dB
	$C_{I,0} = -9$ dB	$C_I = 1$ dB	$C_{I,r} = 1$ dB	$C_{IA} = -11$ dB

The results reported in this document relate only to the sample, product or item delivered to LGAI Technological Center the appointed day having been tested under the conditions established in this document.

**ANNEX. TECHNICAL INFORMATION PROVIDED BY THE TEST PETITIONER**