


# Eagle One Prima

## Installation Requirements



### Water

- 3/8" dedicated cold water line with shut-off valve and compression fitting. (Direct connect version only)
- Water hardness 3gpg or 50 ppm.
- Line pressure 2-4bar, cold water.
- Water flow rate Minimum 1 GPM
- Filtration  $\leq 1.0$  micron
- TDS 50-250 ppm
- Alkalinity 10-150 ppm
- Chlorine  $\leq 0.50$  ppm
- PH 6.5-8.5



Shut off valve




Nema 5-15 (receptacle)

### Power

- Volts: 110 (range of 110-115)
- Watts: 2800
- Amp draw: 15
- Receptacle: Nema 5-15

### Counter Space

- Height: 15 inches
- Depth: 20 inches
- Width: 16.25 inches

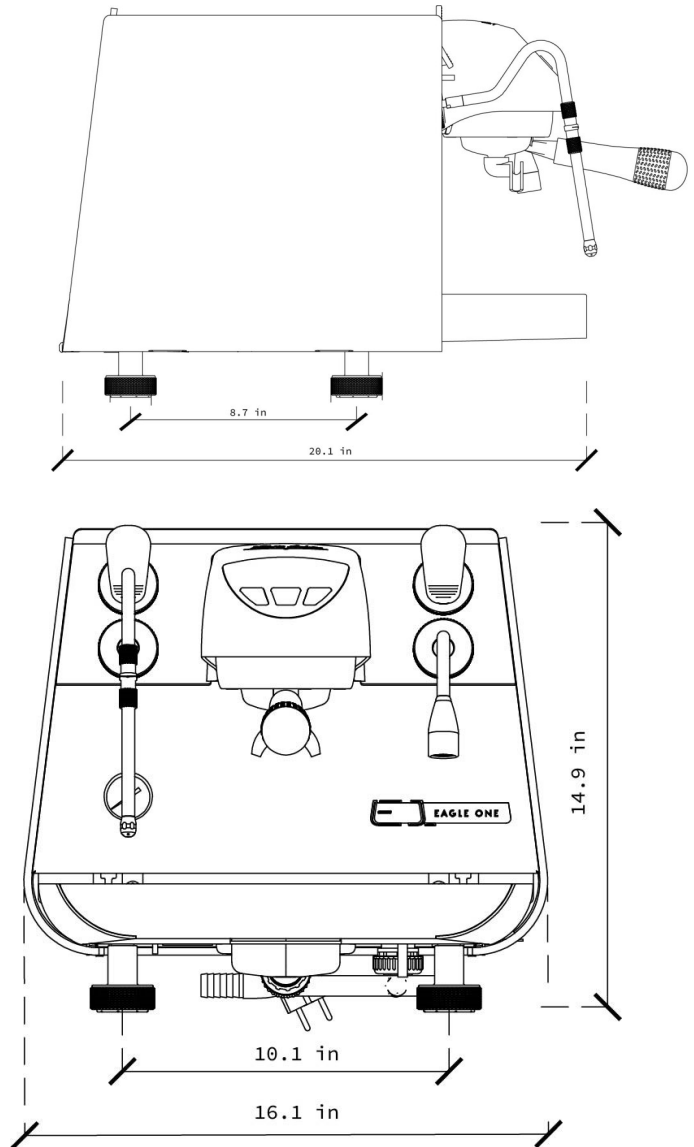

I, the customer, understand that these requirements must be in when the installer arrives. Failure to have the site ready will result in additional service and travel charges, and may cause further delays in installation.

Customer Name: \_\_\_\_\_ Signature: \_\_\_\_\_

Company Name: \_\_\_\_\_

Phone: \_\_\_\_\_ Email: \_\_\_\_\_ Reference number: \_\_\_\_\_