

Report No.: 1

Test Time: 2019/3/28 16:45

Luminaire Property

Luminaire Manufacturer: HAVIT LIGHTING
 Luminaire Description: HV5823T-4000K
 Current: 0.054 A
 Power Factor: 0.888

Voltage: 220 V
 Power: 10.58 W

Photometric Results

CIE Class: Direct
 Measurement Flux: 881.4 lm
 Downward Ratio: 99%
 Horizontal Diffuse Angle(50%): H49.7
 Vertical Diffuse Angle(50%): V49.4
 Luminaire Efficacy Rating (LER): 83.36
 Max. Intensity: 1143.82 cd
 S/MH(C0/C180): 0.75


Total Rated Lamp Lumens: 881.4 lm
 Efficiency: 100%
 Upward Ratio: 1%

Central Intensity: 1139 cd
 Pos of Max. Intensity: H135 V0
 S/MH(C90/C270): 0.74

Picture Of Luminaire



Luminous Intensity Distribution Curve

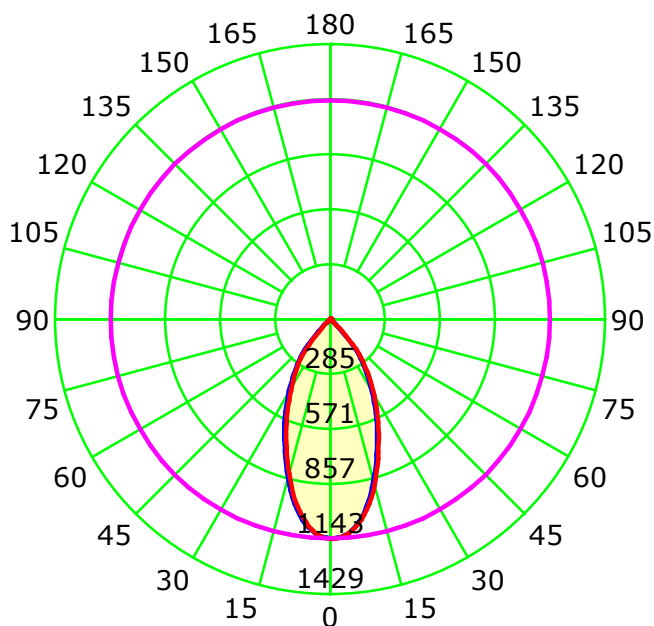

Unit: cd



Average Diffuse Angle(50%): 49.6°

— C0-C180 — C90-C270 — G0

C Plane (°):0.0-360.0: 45.0
 Test Lab: Havit Lighting
 Test Type: TYPE C
 Temperature: 26
 Operator: Jacky tang

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 7.970 m
 Humidity: 55
 Inspector:

Luminous Intensity Distribution Curve

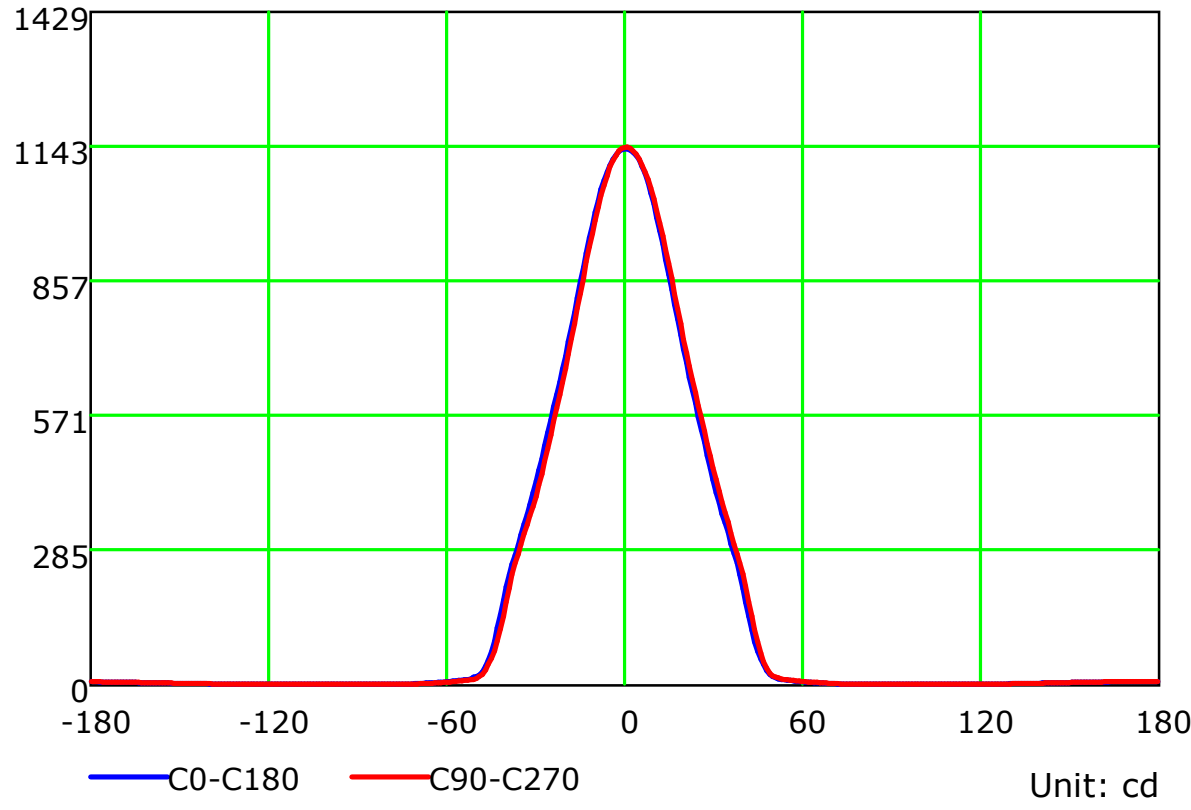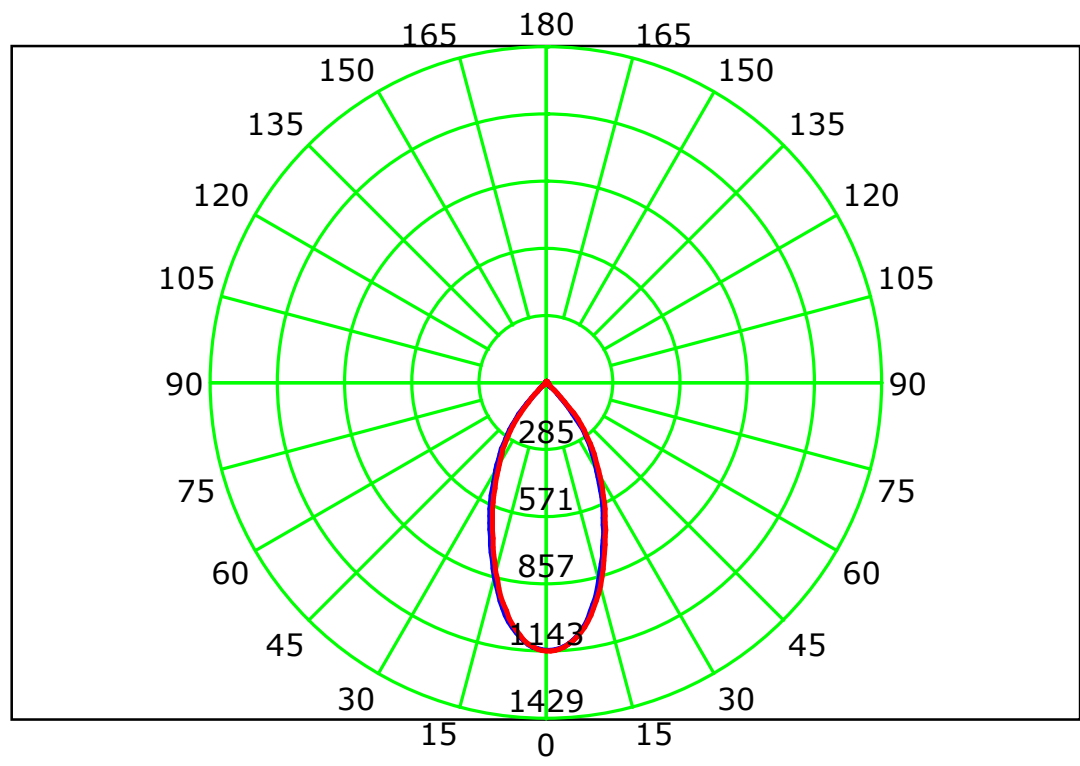

C Plane (°):0.0-360.0: 45.0
 Test Lab: Havit Lighting
 Test Type: TYPE C
 Temperature: 26
 Operator: Jacky tang

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 7.970 m
 Humidity: 55
 Inspector:


Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	101	101	101	99
1	113	111	108	106	111	108	106	104	104	102	101	100	99	98	97	96	95	93
2	108	103	99	95	105	101	97	94	98	95	92	95	92	90	92	90	88	86
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75
5	92	84	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69
6	87	78	72	68	86	78	72	68	76	71	67	75	70	67	73	69	66	65
7	83	74	68	63	82	73	67	63	72	67	63	70	66	63	69	65	62	61
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	61	58	57
9	75	66	60	56	74	65	59	56	64	59	55	63	58	55	62	58	55	54
10	72	62	56	52	71	62	56	52	61	56	52	60	55	52	59	55	52	50

Spacing Criteria (0-180): 0.75

Spacing Criteria (90-270): 0.74


Spacing Criteria (Diagonal): 0.81

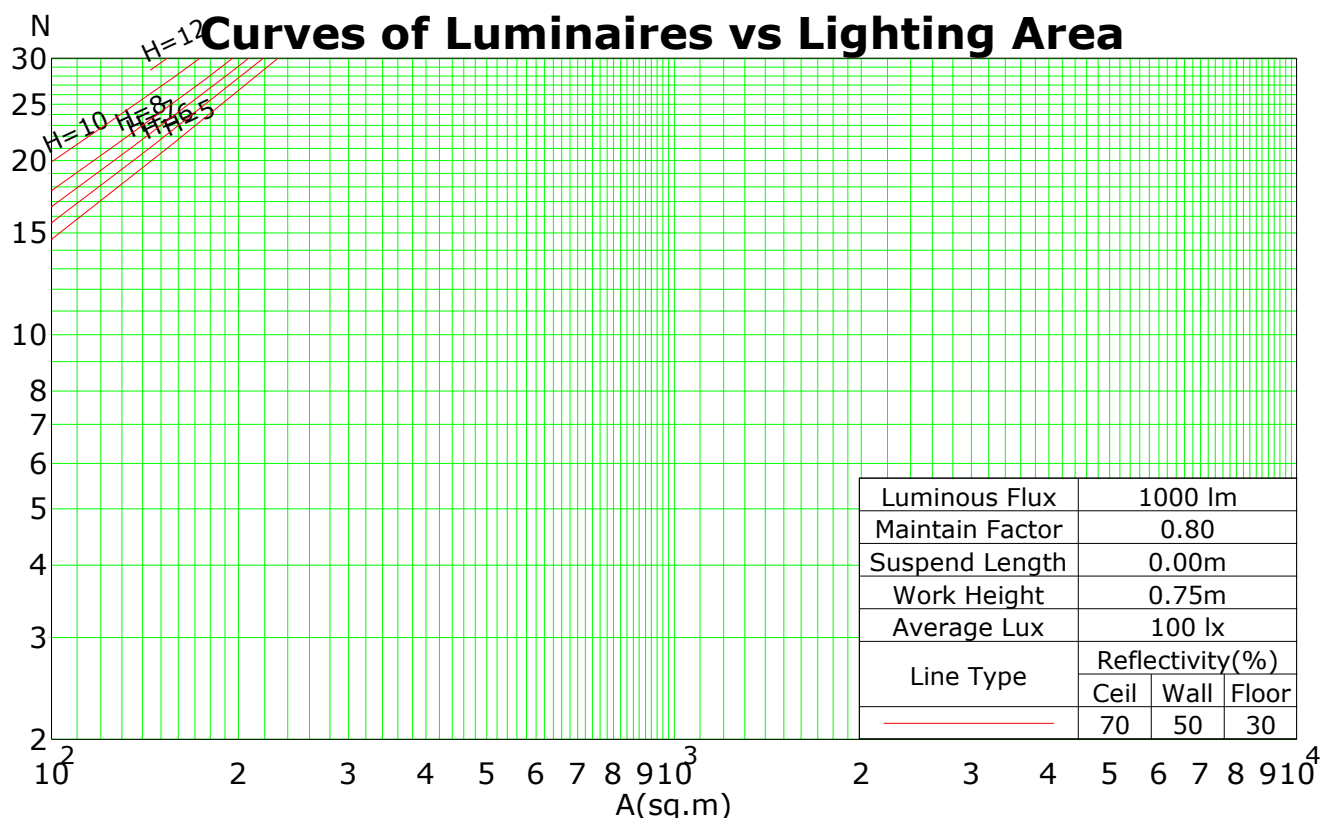

C Plane (°):0.0-360.0: 45.0
 Test Lab: Havit Lighting
 Test Type: TYPE C
 Temperature: 26
 Operator: Jacky tang

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 7.970 m
 Humidity: 55
 Inspector:

Isocandela (rectangle)

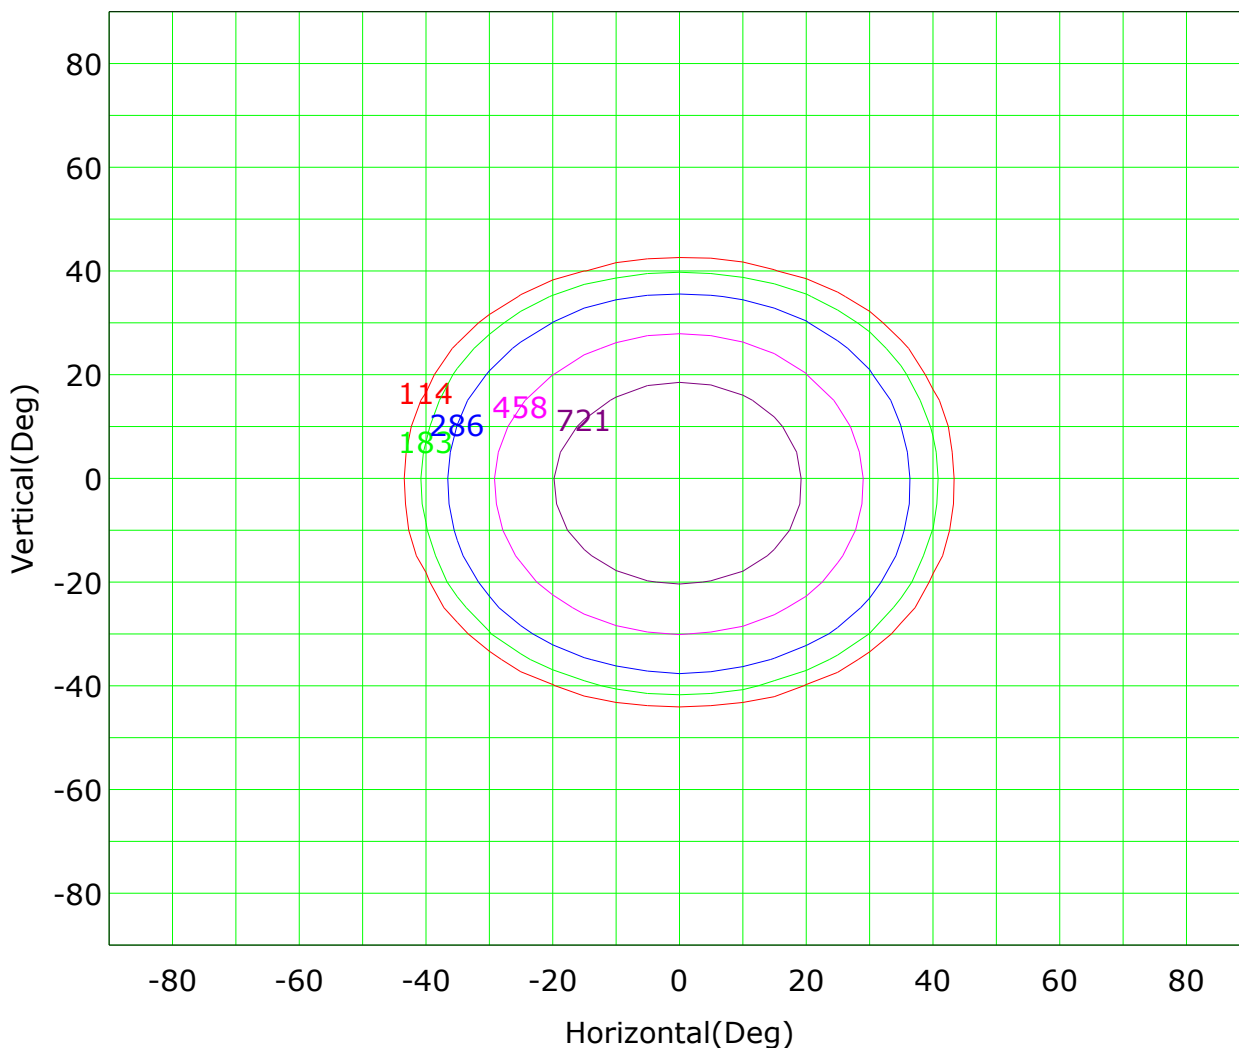


Imax (100%): 1144 cd

(10%): 114 cd	(16%): 183 cd
(25%): 286 cd	(40%): 458 cd
(63%): 721 cd	(100%): 1144 cd

C Plane (°):0.0-360.0: 45.0
 Test Lab: Havit Lighting
 Test Type: TYPE C
 Temperature: 26
 Operator: Jacky tang

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 7.970 m
 Humidity: 55
 Inspector:

IsoLux Plot

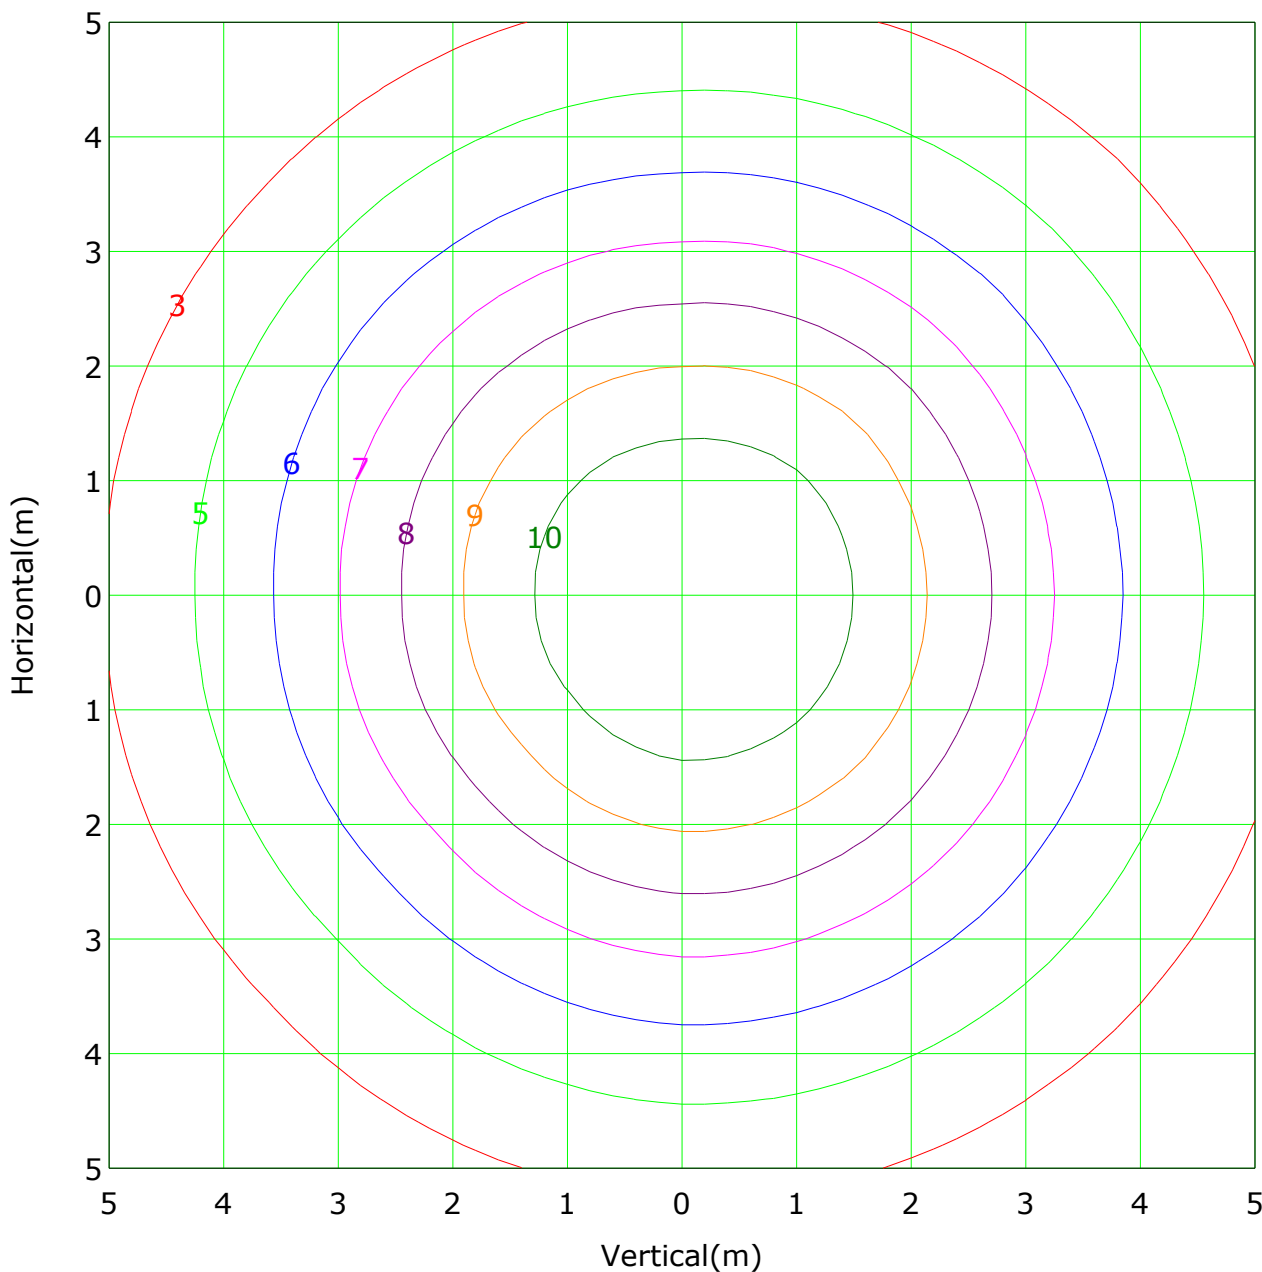



Mounting Height: 10.0m		Max Lux(100%): 11.4 lx	
(30%):	3.4 lx	(40%):	4.6 lx
(50%):	5.7 lx	(60%):	6.9 lx
(70%):	8.0 lx	(80%):	9.2 lx
(90%):	10.3 lx	(100%):	11.4 lx
(120%):	13.7 lx	(150%):	17.2 lx

C Plane (°):0.0-360.0: 45.0
 Test Lab: Havit Lighting
 Test Type: TYPE C
 Temperature: 26
 Operator: Jacky tang

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 7.970 m
 Humidity: 55
 Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

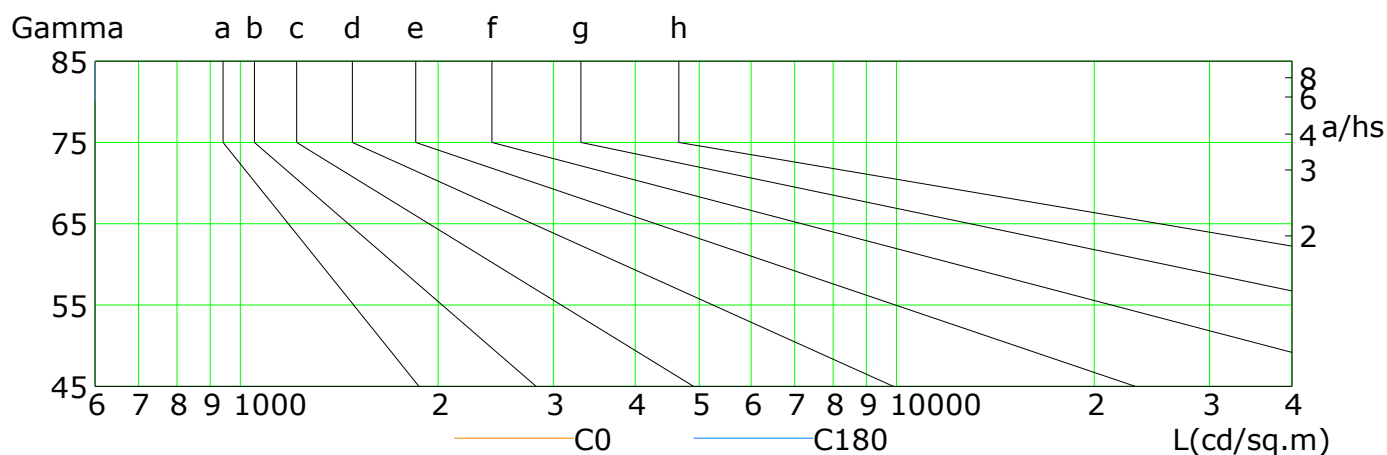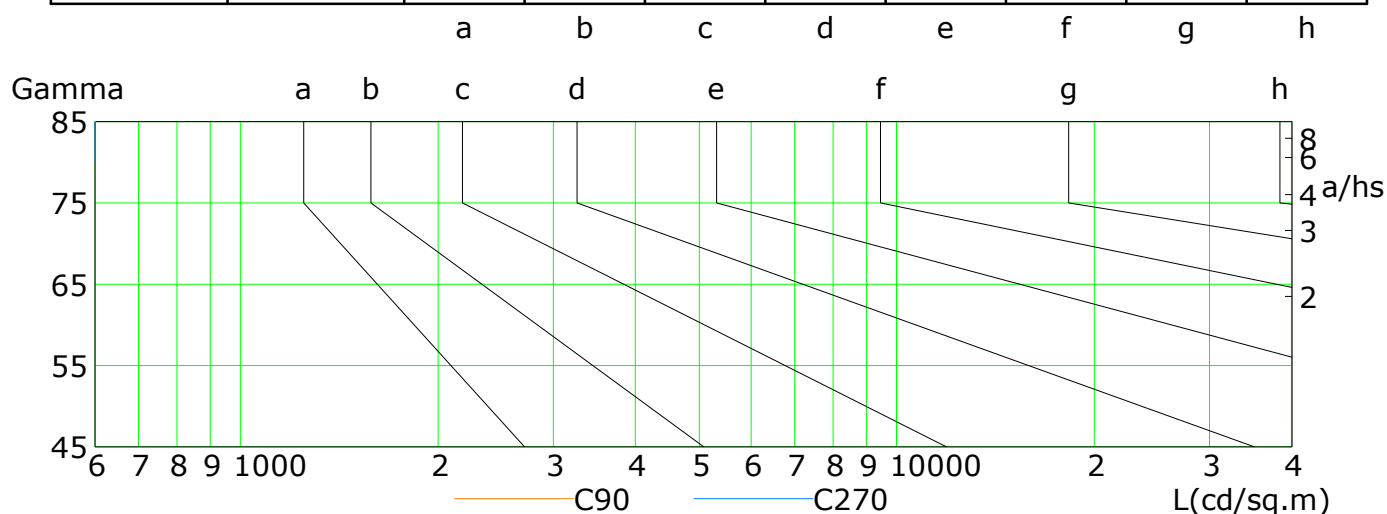


L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	70	17	9	6	3	2	0	0	0
C90	90	18	10	7	4	2	1	0	0
C180	69	17	9	6	4	2	0	0	0
C270	55	14	8	5	3	1	0	0	0

C Plane (°):0.0-360.0: 45.0
 Test Lab: Havit Lighting
 Test Type: TYPE C
 Temperature: 26
 Operator: Jacky tang

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 7.970 m
 Humidity: 55
 Inspector:


Illuminance at a Distance

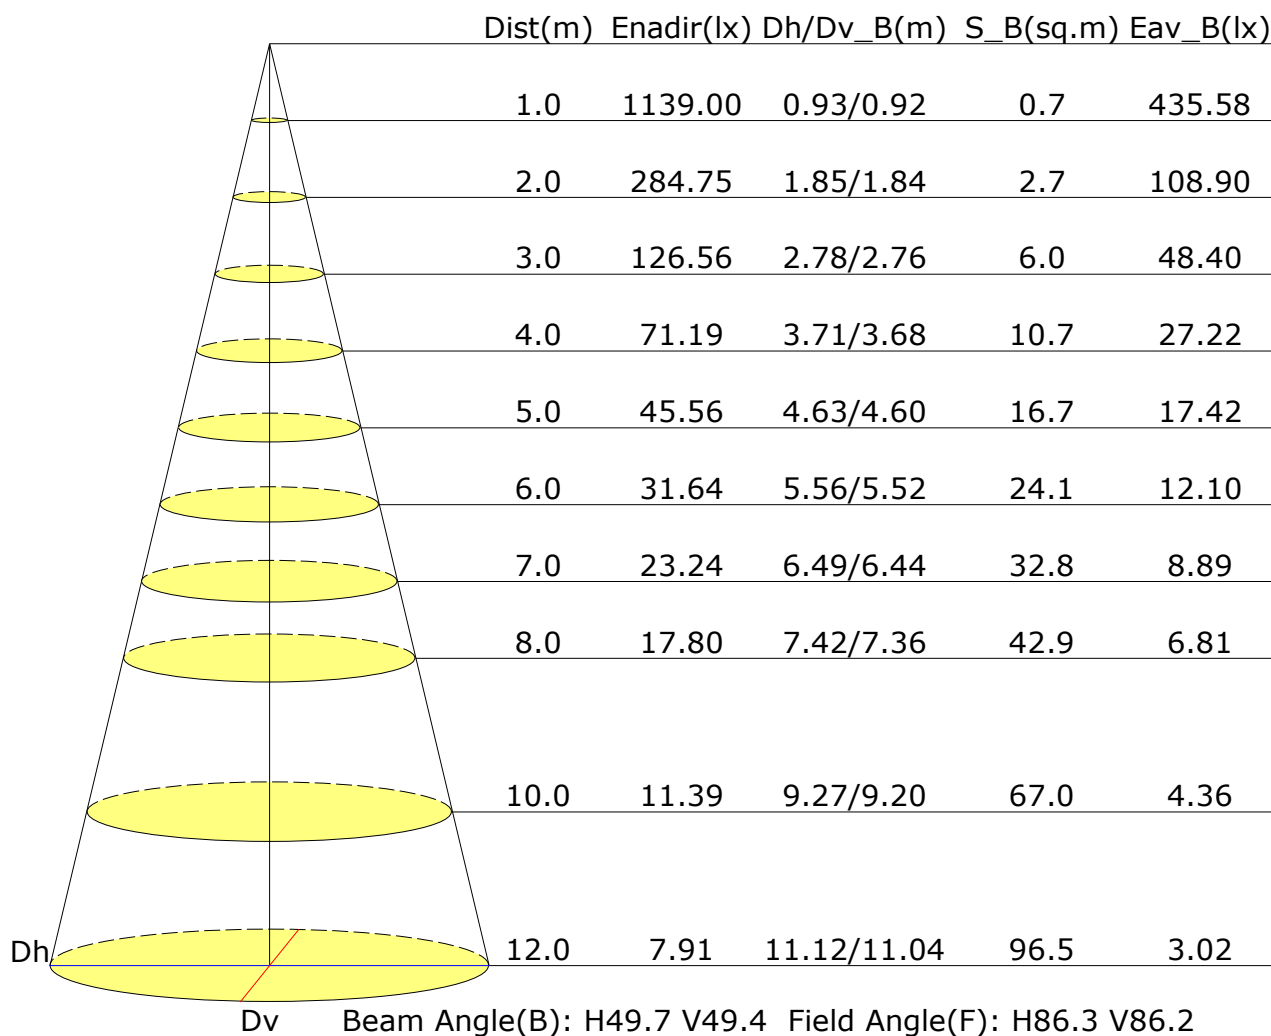

C Plane (°):0.0-360.0: 45.0
 Test Lab: Havit Lighting
 Test Type: TYPE C
 Temperature: 26
 Operator: Jacky tang

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 7.970 m
 Humidity: 55
 Inspector:

Vertical IsoLux Plot

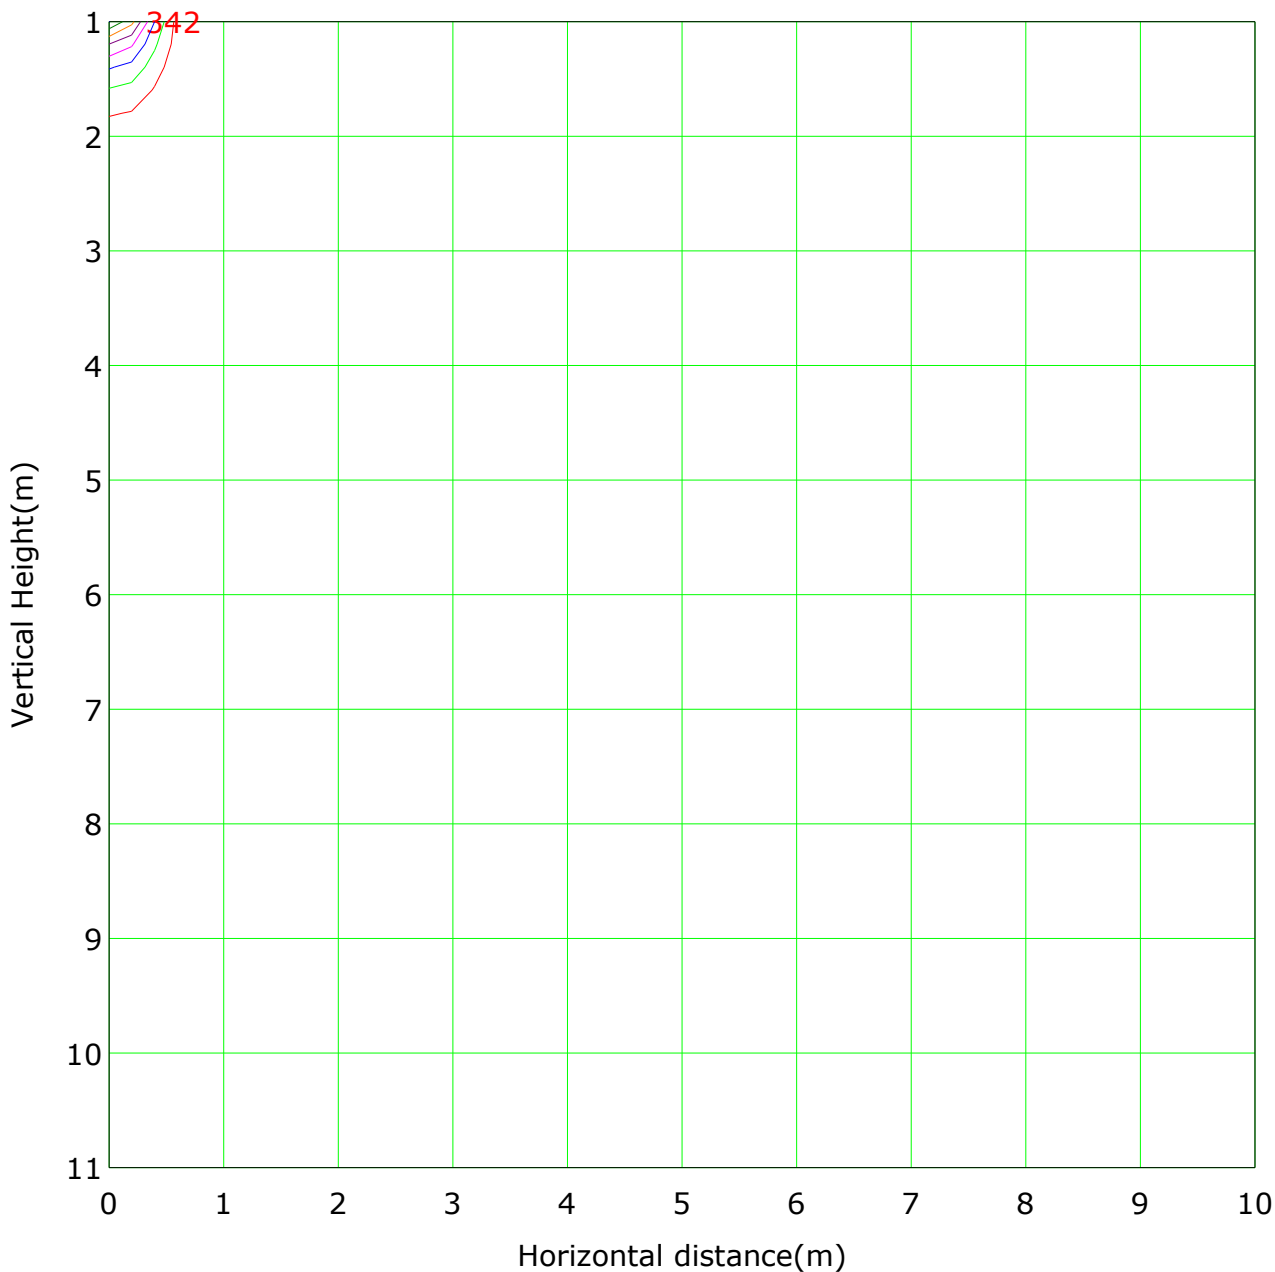


Lowest(m): 1.0m	Highest(m): 11.0m	Max Lux: 1139.0 lx
(30%): 341.7 lx	(40%): 455.6 lx	
(50%): 569.5 lx	(60%): 683.4 lx	
(70%): 797.3 lx	(80%): 911.2 lx	
(90%):1025.1 lx	(100%):1139.0 lx	
(120%):1366.8 lx	(150%):1708.5 lx	

C Plane (°):0.0-360.0: 45.0
 Test Lab: Havit Lighting
 Test Type: TYPE C
 Temperature: 26
 Operator: Jacky tang

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 7.970 m
 Humidity: 55
 Inspector:

The Average Illuminance Effective Figure

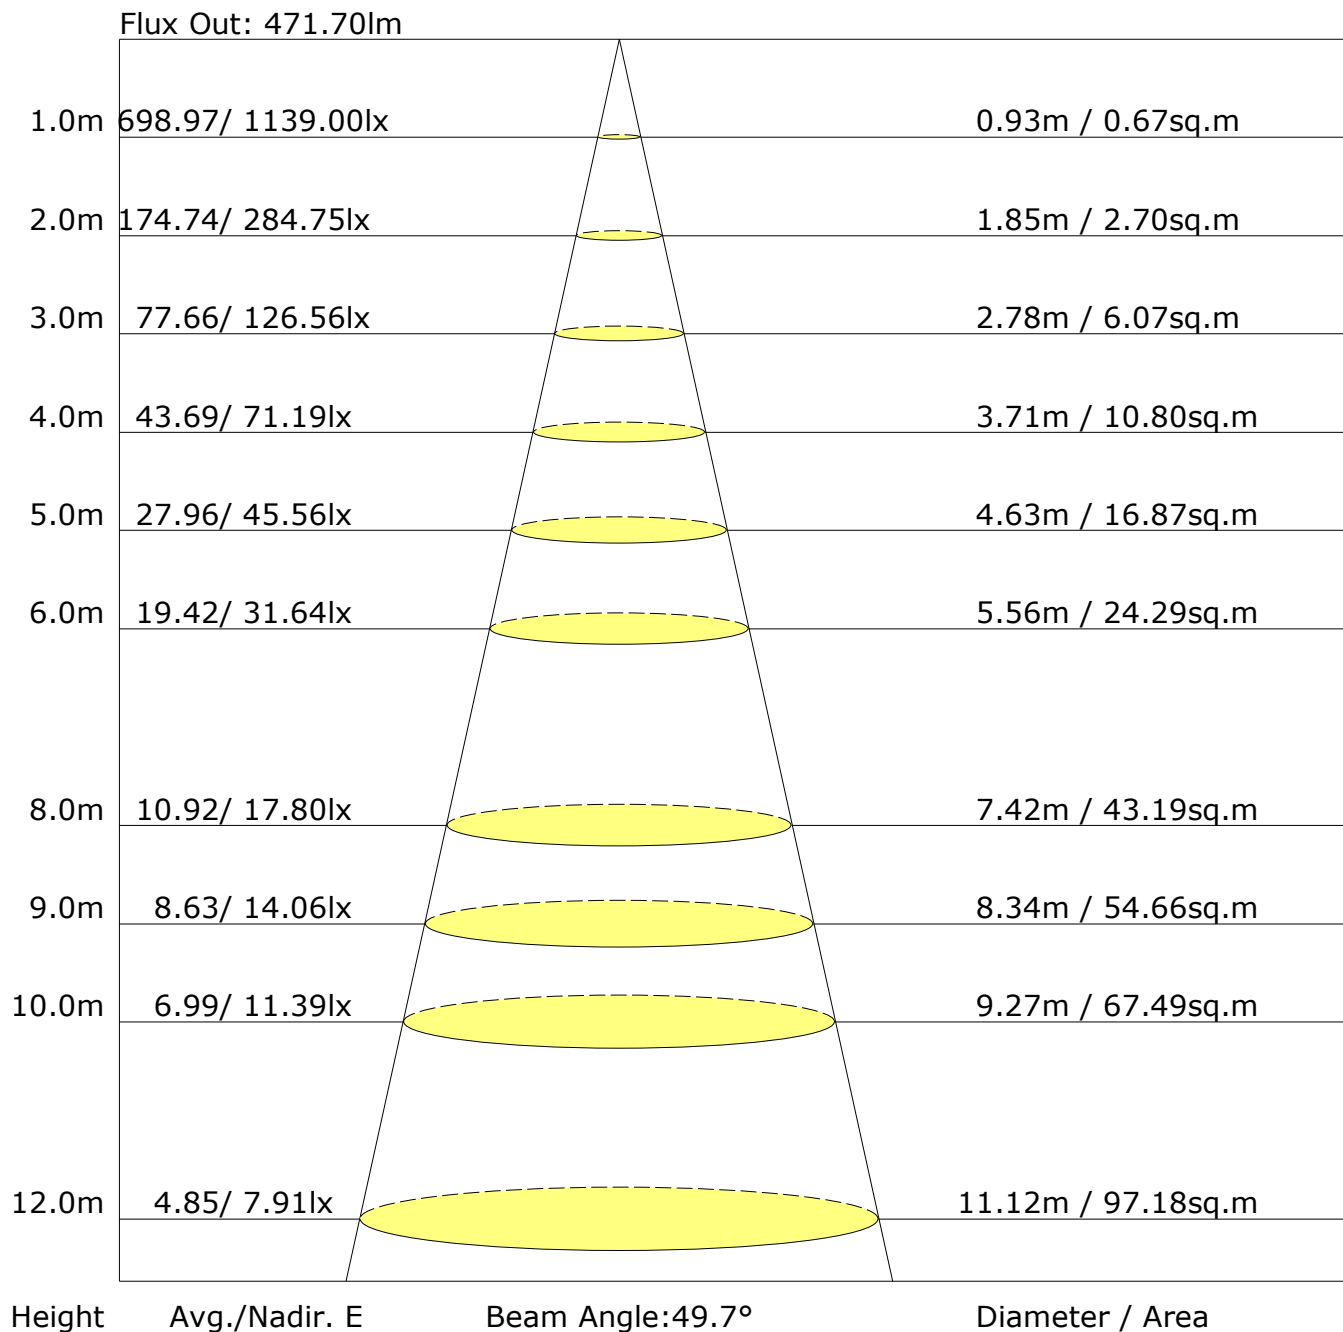

C Plane (°):0.0-360.0: 45.0
 Test Lab: Havit Lighting
 Test Type: TYPE C
 Temperature: 26
 Operator: Jacky tang

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 7.970 m
 Humidity: 55
 Inspector:

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
3H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
12H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
X=4H Y=2H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
3H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
12H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
X=8H Y=4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
12H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
X=12H Y=4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
Variations with the observer position at spacings:										
S=1.0H	-1.\$/-1.\$					-1.\$/-1.\$				
S=1.5H	-1.\$/-1.\$					-1.\$/-1.\$				
S=2.0H	-1.\$/-1.\$					-1.\$/-1.\$				

Calculate in accordance with CIE Pub.117. The table is revised with 881lm ($8\log(F/F_0) = -0.4$).

C Plane (°):0.0-360.0: 45.0
 Test Lab: Havit Lighting
 Test Type: TYPE C
 Temperature: 26
 Operator: Jacky tang

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 7.970 m
 Humidity: 55
 Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C45.0	C90.0	C135.0	C180.0	C225.0	C270.0	C315.0	C360.0	
G0.0	1139.0	1142.8	1142.4	1143.8	1139.0	1142.8	1142.4	1143.8	1139.0	
G1.0	1138.8	1142.7	1142.5	1143.3	1137.3	1141.0	1140.1	1141.9	1138.8	
G2.0	1136.8	1140.3	1139.9	1140.5	1133.1	1136.6	1135.0	1137.2	1136.8	
G3.0	1132.7	1136.5	1134.6	1134.9	1126.3	1129.4	1126.0	1129.6	1132.7	
G4.0	1125.1	1130.0	1127.7	1127.6	1117.2	1118.8	1114.4	1118.6	1125.1	
G5.0	1115.6	1120.1	1117.9	1118.0	1104.3	1106.3	1100.3	1103.1	1115.6	
G6.0	1102.7	1108.4	1105.0	1105.5	1089.6	1090.4	1081.6	1085.8	1102.7	
G7.0	1086.9	1094.1	1090.5	1089.9	1072.5	1069.5	1061.6	1065.4	1086.9	
G8.0	1066.4	1075.4	1074.1	1073.2	1053.1	1048.6	1039.6	1043.2	1066.4	
G9.0	1045.0	1055.9	1055.4	1053.8	1028.9	1025.4	1015.7	1016.5	1045.0	
G10.0	1021.4	1033.9	1032.3	1030.6	1004.0	1000.2	987.1	989.9	1021.4	
G11.0	993.0	1007.2	1008.9	1006.8	977.6	972.7	959.5	962.0	993.0	
G12.0	965.3	980.7	981.1	981.3	949.6	940.9	930.1	932.2	965.3	
G13.0	936.5	952.4	953.9	953.7	917.6	911.2	899.4	898.9	936.5	
G14.0	903.2	923.0	925.6	921.5	887.6	880.6	864.5	867.6	903.2	
G15.0	871.8	888.7	895.3	890.7	856.5	849.1	831.8	835.5	871.8	
G16.0	839.8	857.0	863.9	859.0	821.6	813.9	799.3	799.9	839.8	
G17.0	807.9	824.9	829.6	827.4	790.1	781.9	767.3	767.7	807.9	
G18.0	776.4	793.5	798.4	792.8	759.1	750.2	735.9	736.3	776.4	
G19.0	742.9	759.7	767.2	762.1	729.1	719.3	701.6	705.5	742.9	
G20.0	713.0	729.8	733.9	732.5	697.9	689.8	671.5	676.0	713.0	
G21.0	684.0	700.9	705.0	701.7	670.3	661.3	641.7	647.1	684.0	
G22.0	653.1	670.5	677.2	674.9	643.4	630.2	615.6	616.2	653.1	
G23.0	625.5	643.2	647.1	648.0	616.7	601.1	587.1	588.5	625.5	
G24.0	598.4	616.2	620.1	618.7	590.0	572.4	558.5	561.0	598.4	
G25.0	568.7	589.6	593.4	591.6	563.1	544.1	530.4	533.7	568.7	
G26.0	541.8	560.2	567.0	564.9	535.4	513.3	502.4	505.9	541.8	
G27.0	514.9	533.6	538.3	537.7	507.7	485.3	475.2	479.1	514.9	
G28.0	487.3	505.8	511.8	509.8	480.6	459.5	447.8	454.1	487.3	
G29.0	459.9	478.2	485.6	482.7	455.0	435.1	424.0	428.2	459.9	
G30.0	434.6	451.9	460.5	454.3	432.5	408.0	399.8	403.9	434.6	
G31.0	408.1	425.2	436.0	430.2	408.3	384.2	377.3	381.4	408.1	
G32.0	385.6	402.6	410.7	404.6	382.5	364.2	359.1	362.5	385.6	
G33.0	363.2	378.1	388.3	380.9	361.4	346.1	340.3	344.4	363.2	
G34.0	344.5	358.0	365.4	360.4	341.4	326.0	320.3	322.8	344.5	
G35.0	323.5	337.1	344.5	340.4	317.9	303.1	298.2	297.5	323.5	
G36.0	298.9	311.0	322.0	318.6	295.5	281.7	277.6	277.5	298.9	

C Plane (°):0.0-360.0: 45.0
 Test Lab: Havit Lighting
 Test Type: TYPE C
 Temperature: 26
 Operator: Jacky tang

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 7.970 m
 Humidity: 55
 Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C45.0	C90.0	C135.0	C180.0	C225.0	C270.0	C315.0	C360.0	
G37.0	278.0	288.3	297.5	296.0	274.5	262.5	257.9	259.8	278.0	
G38.0	258.0	268.1	277.4	274.6	255.5	241.1	233.8	237.9	258.0	
G39.0	233.5	246.9	258.5	250.8	232.9	216.2	204.4	209.4	233.5	
G40.0	203.3	218.1	235.5	224.2	207.0	189.2	175.0	180.7	203.3	
G41.0	174.3	189.6	208.6	195.4	179.4	161.7	145.4	151.1	174.3	
G42.0	145.0	160.9	175.5	165.6	147.1	133.5	117.2	121.9	145.0	
G43.0	115.4	133.7	145.7	133.9	120.6	105.7	92.0	93.7	115.4	
G44.0	90.9	104.3	116.5	106.7	91.3	81.8	71.4	69.4	90.9	
G45.0	70.1	80.6	90.0	83.1	69.0	61.4	55.0	51.3	70.1	
G46.0	54.0	61.9	65.6	62.7	51.3	47.9	42.4	36.0	54.0	
G47.0	42.5	46.6	49.0	49.1	38.7	34.5	30.0	24.0	42.5	
G48.0	28.9	32.6	34.9	36.8	26.2	23.9	21.4	18.1	28.9	
G49.0	20.9	22.0	23.6	23.9	19.8	19.2	17.3	15.3	20.9	
G50.0	17.3	17.1	18.1	18.3	16.9	16.3	13.5	12.9	17.3	
G51.0	14.8	15.1	15.7	16.0	15.0	11.9	10.6	10.6	14.8	
G52.0	11.5	13.1	14.1	14.2	11.6	10.8	9.6	9.7	11.5	
G53.0	10.4	11.0	12.1	11.3	10.6	9.8	8.9	8.9	10.4	
G54.0	9.6	10.1	10.6	10.3	9.8	9.1	8.2	8.2	9.6	
G55.0	8.9	9.3	9.8	9.6	9.0	8.3	7.6	7.6	8.9	
G56.0	8.2	8.6	9.0	8.8	8.3	7.7	7.0	7.0	8.2	
G57.0	7.5	7.9	8.3	8.1	7.7	7.0	6.3	6.4	7.5	
G58.0	6.8	7.3	7.7	7.5	7.0	6.4	5.8	5.8	6.8	
G59.0	6.3	6.7	7.1	6.8	6.5	5.8	5.3	5.3	6.3	
G60.0	5.7	6.0	6.5	6.4	5.9	5.2	4.8	4.8	5.7	
G61.0	5.1	5.6	5.9	5.9	5.3	4.8	4.2	4.4	5.1	
G62.0	4.7	5.1	5.4	5.3	4.9	4.3	3.8	3.9	4.7	
G63.0	4.3	4.6	5.0	4.8	4.4	3.9	3.4	3.5	4.3	
G64.0	3.8	4.2	4.5	4.4	4.0	3.5	3.0	3.1	3.8	
G65.0	3.5	3.8	4.1	4.0	3.6	3.1	2.6	2.8	3.5	
G66.0	3.1	3.4	3.7	3.6	3.3	2.7	2.3	2.4	3.1	
G67.0	2.8	3.1	3.3	3.2	2.9	2.4	2.0	2.1	2.8	
G68.0	2.5	2.7	2.9	2.8	2.5	2.1	1.7	1.8	2.5	
G69.0	2.2	2.3	2.5	2.5	2.2	1.8	1.4	1.5	2.2	
G70.0	1.9	2.0	2.2	2.1	1.9	1.5	1.1	1.2	1.9	
G71.0	1.6	1.6	1.9	1.8	1.6	1.2	0.8	0.9	1.6	
G72.0	1.3	1.3	1.5	1.5	1.3	0.9	0.6	0.7	1.3	
G73.0	1.0	1.1	1.2	1.2	1.0	0.6	0.4	0.4	1.0	

C Plane (°):0.0-360.0: 45.0
 Test Lab: Havit Lighting
 Test Type: TYPE C
 Temperature: 26
 Operator: Jacky tang

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 7.970 m
 Humidity: 55
 Inspector:

Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C45.0	C90.0	C135.0	C180.0	C225.0	C270.0	C315.0	C360.0	
G74.0	0.7	0.8	0.9	0.9	0.7	0.4	0.2	0.2	0.7	
G75.0	0.4	0.5	0.6	0.6	0.4	0.2	0.1	0.1	0.4	
G76.0	0.3	0.2	0.3	0.3	0.2	0.1	0.0	0.0	0.3	
G77.0	0.1	0.1	0.1	0.2	0.1	0.0	0.0	0.0	0.1	
G78.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	
G79.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	
G80.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	
G81.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G82.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G83.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G84.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G85.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G86.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G87.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G88.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G89.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G90.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G91.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G92.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G93.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G94.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	
G95.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G96.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G97.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G98.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G99.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G100.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G101.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G102.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G103.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G104.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G105.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G106.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G107.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
G108.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	
G109.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	
G110.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.1	0.0	

C Plane (°):0.0-360.0: 45.0
 Test Lab: Havit Lighting
 Test Type: TYPE C
 Temperature: 26
 Operator: Jacky tang

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 7.970 m
 Humidity: 55
 Inspector:

Candlepower Table (Continue 3)

Unit: cd

G\C	C0.0	C45.0	C90.0	C135.0	C180.0	C225.0	C270.0	C315.0	C360.0	
G111.0	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.1	
G112.0	0.1	0.1	0.1	0.1	0.0	0.0	0.1	0.1	0.1	
G113.0	0.1	0.1	0.1	0.1	0.0	0.0	0.1	0.1	0.1	
G114.0	0.1	0.1	0.1	0.2	0.1	0.1	0.1	0.1	0.1	
G115.0	0.2	0.1	0.2	0.2	0.1	0.1	0.1	0.1	0.2	
G116.0	0.2	0.2	0.2	0.2	0.1	0.1	0.1	0.1	0.2	
G117.0	0.2	0.2	0.3	0.3	0.1	0.1	0.1	0.1	0.2	
G118.0	0.3	0.3	0.3	0.3	0.1	0.2	0.2	0.2	0.3	
G119.0	0.4	0.4	0.4	0.4	0.2	0.1	0.2	0.2	0.4	
G120.0	0.4	0.4	0.4	0.4	0.2	0.2	0.2	0.3	0.4	
G121.0	0.5	0.5	0.5	0.5	0.2	0.3	0.3	0.3	0.5	
G122.0	0.6	0.6	0.6	0.6	0.3	0.2	0.3	0.3	0.6	
G123.0	0.7	0.6	0.6	0.7	0.3	0.3	0.3	0.4	0.7	
G124.0	0.8	0.7	0.7	0.8	0.4	0.4	0.4	0.4	0.8	
G125.0	0.9	0.8	0.8	0.9	0.4	0.4	0.4	0.4	0.9	
G126.0	1.0	0.9	0.9	0.9	0.4	0.4	0.5	0.5	1.0	
G127.0	1.1	1.0	1.0	1.0	0.5	0.5	0.5	0.6	1.1	
G128.0	1.2	1.2	1.1	1.1	0.6	0.6	0.6	0.6	1.2	
G129.0	1.3	1.3	1.2	1.2	0.6	0.6	0.6	0.7	1.3	
G130.0	1.4	1.4	1.3	1.4	0.6	0.6	0.7	0.7	1.4	
G131.0	1.5	1.4	1.4	1.5	0.7	0.7	0.8	0.8	1.5	
G132.0	1.6	1.5	1.5	1.6	0.7	0.8	0.9	0.9	1.6	
G133.0	1.7	1.6	1.6	1.7	0.8	0.9	0.9	0.9	1.7	
G134.0	1.9	1.8	1.8	1.8	0.9	0.9	1.0	1.0	1.9	
G135.0	2.0	1.9	1.9	2.0	0.9	1.0	1.0	1.0	2.0	
G136.0	2.1	2.0	2.0	2.0	1.0	1.1	1.1	1.1	2.1	
G137.0	2.2	2.2	2.1	2.2	1.1	1.2	1.1	1.2	2.2	
G138.0	2.4	2.3	2.2	2.3	1.2	1.2	1.3	1.3	2.4	
G139.0	2.5	2.4	2.3	2.4	1.3	1.3	1.3	1.4	2.5	
G140.0	2.7	2.5	2.5	2.6	1.3	1.4	1.4	1.5	2.7	
G141.0	2.8	2.7	2.6	2.7	1.5	1.5	1.5	1.5	2.8	
G142.0	2.9	2.8	2.7	2.8	1.5	1.6	1.6	1.6	2.9	
G143.0	3.0	3.0	2.9	3.0	1.6	1.7	1.7	1.7	3.0	
G144.0	3.2	3.1	3.1	3.1	1.7	1.8	1.8	1.8	3.2	
G145.0	3.4	3.3	3.2	3.3	1.8	1.9	1.8	1.9	3.4	
G146.0	3.5	3.4	3.4	3.5	1.9	2.0	2.0	2.0	3.5	
G147.0	3.6	3.6	3.5	3.6	2.0	2.1	2.1	2.1	3.6	

C Plane (°):0.0-360.0: 45.0
 Test Lab: Havit Lighting
 Test Type: TYPE C
 Temperature: 26
 Operator: Jacky tang

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 7.970 m
 Humidity: 55
 Inspector:

Candlepower Table (Continue 4)

Unit: cd

G\C	C0.0	C45.0	C90.0	C135.0	C180.0	C225.0	C270.0	C315.0	C360.0	
G148.0	3.8	3.7	3.7	3.7	2.1	2.2	2.2	2.2	3.8	
G149.0	3.9	3.9	3.8	3.9	2.2	2.3	2.3	2.3	3.9	
G150.0	4.1	4.0	4.0	4.0	2.3	2.3	2.4	2.4	4.1	
G151.0	4.2	4.2	4.1	4.1	2.4	2.5	2.5	2.5	4.2	
G152.0	4.4	4.3	4.3	4.3	2.5	2.5	2.6	2.7	4.4	
G153.0	4.4	4.4	4.4	4.4	2.6	2.7	2.7	2.7	4.4	
G154.0	4.6	4.6	4.5	4.6	2.7	2.8	2.8	2.9	4.6	
G155.0	4.7	4.7	4.6	4.7	2.8	2.9	3.0	3.0	4.7	
G156.0	4.8	4.8	4.8	4.8	2.9	3.0	3.0	3.1	4.8	
G157.0	4.9	4.9	4.9	5.0	3.1	3.1	3.2	3.2	4.9	
G158.0	5.1	5.0	5.0	5.1	3.2	3.2	3.3	3.3	5.1	
G159.0	5.1	5.2	5.1	5.2	3.3	3.4	3.5	3.5	5.1	
G160.0	5.3	5.3	5.3	5.3	3.5	3.5	3.6	3.6	5.3	
G161.0	5.4	5.4	5.3	5.4	3.5	3.6	3.8	3.7	5.4	
G162.0	5.4	5.4	5.5	5.5	3.7	3.8	3.9	3.8	5.4	
G163.0	5.4	5.5	5.5	5.6	3.8	3.9	4.0	4.0	5.4	
G164.0	5.6	5.6	5.6	5.6	4.0	4.0	4.2	4.1	5.6	
G165.0	5.6	5.6	5.7	5.7	4.1	4.2	4.3	4.3	5.6	
G166.0	5.7	5.7	5.7	5.8	4.2	4.3	4.4	4.4	5.7	
G167.0	5.7	5.7	5.8	5.8	4.4	4.4	4.5	4.5	5.7	
G168.0	5.7	5.8	5.8	5.8	4.5	4.6	4.6	4.6	5.7	
G169.0	5.8	5.8	5.9	5.8	4.6	4.7	4.8	4.8	5.8	
G170.0	5.8	5.8	5.9	5.9	4.8	4.8	4.9	4.9	5.8	
G171.0	5.8	5.8	5.9	5.9	4.9	5.0	5.0	5.0	5.8	
G172.0	5.8	5.8	5.9	5.9	5.0	5.1	5.1	5.1	5.8	
G173.0	5.8	5.9	5.9	5.9	5.1	5.2	5.2	5.2	5.8	
G174.0	5.8	5.8	5.9	5.9	5.2	5.3	5.3	5.3	5.8	
G175.0	5.8	5.8	5.9	5.9	5.3	5.3	5.3	5.4	5.8	
G176.0	5.7	5.8	5.9	5.9	5.3	5.4	5.4	5.4	5.7	
G177.0	5.7	5.8	5.8	5.9	5.4	5.4	5.5	5.5	5.7	
G178.0	5.5	5.8	5.8	5.8	5.5	5.5	5.6	5.6	5.5	
G179.0	5.7	5.7	5.8	5.8	5.5	5.6	5.7	5.7	5.7	
G180.0	5.6	5.7	5.7	5.7	5.6	5.7	5.7	5.7	5.6	

C Plane (°):0.0-360.0: 45.0
 Test Lab: Havit Lighting
 Test Type: TYPE C
 Temperature: 26
 Operator: Jacky tang

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1800B
 Distance: 7.970 m
 Humidity: 55
 Inspector: