

TANK DATA	
DESIGNED TO	AS1692, UL 142, UL2085
BUILT TO	UL142, UL2085
GROSS VOLUME	2,170l
SAFE FILL LEVEL	2,000l
PNEUMATIC TEST	21-35 kPa (INNER & OUTER)
PAINT - EXTERNAL	BASE - HEMPADUR 17360, 50µm INTERMEDIATE - HEMPADUR 15560, 100µm TOP - HEMPADUR 55610, 50µm
PAINT COLOUR	HEMPEL 10000 HIGH-GLOSS WHITE


**IF IN DOUBT ASK.  
DRAWING INFORMATION TAKES PRECEDENCE OVER PARTS LIST**



GENERAL NOTES	
DO NOT SCALE	
UNLESS STATED OTHERWISE:-	
ALL DIMENSIONS IN MILLIMETERS	
ALL THREADS ARE METRIC COARSE	
DEBURR & REMOVE ALL SHARP EDGES	
TOLERANCES:	
TYPE	RANGE TOLERANCE
LINEAR (mm)	0 - 100 ±2.0
	101 - 1000 ±10.0
	> 1000 ±20.0
ANGULAR (minutes)	±0.1°

SCALE	2:1
DWN	MB 12/09/2018
CLIENT	NA
END USER	NA

TITLE	2000L Fire Rated Tank
SHEET 1 OF 2	
DRAWING NUMBER	
REV	A

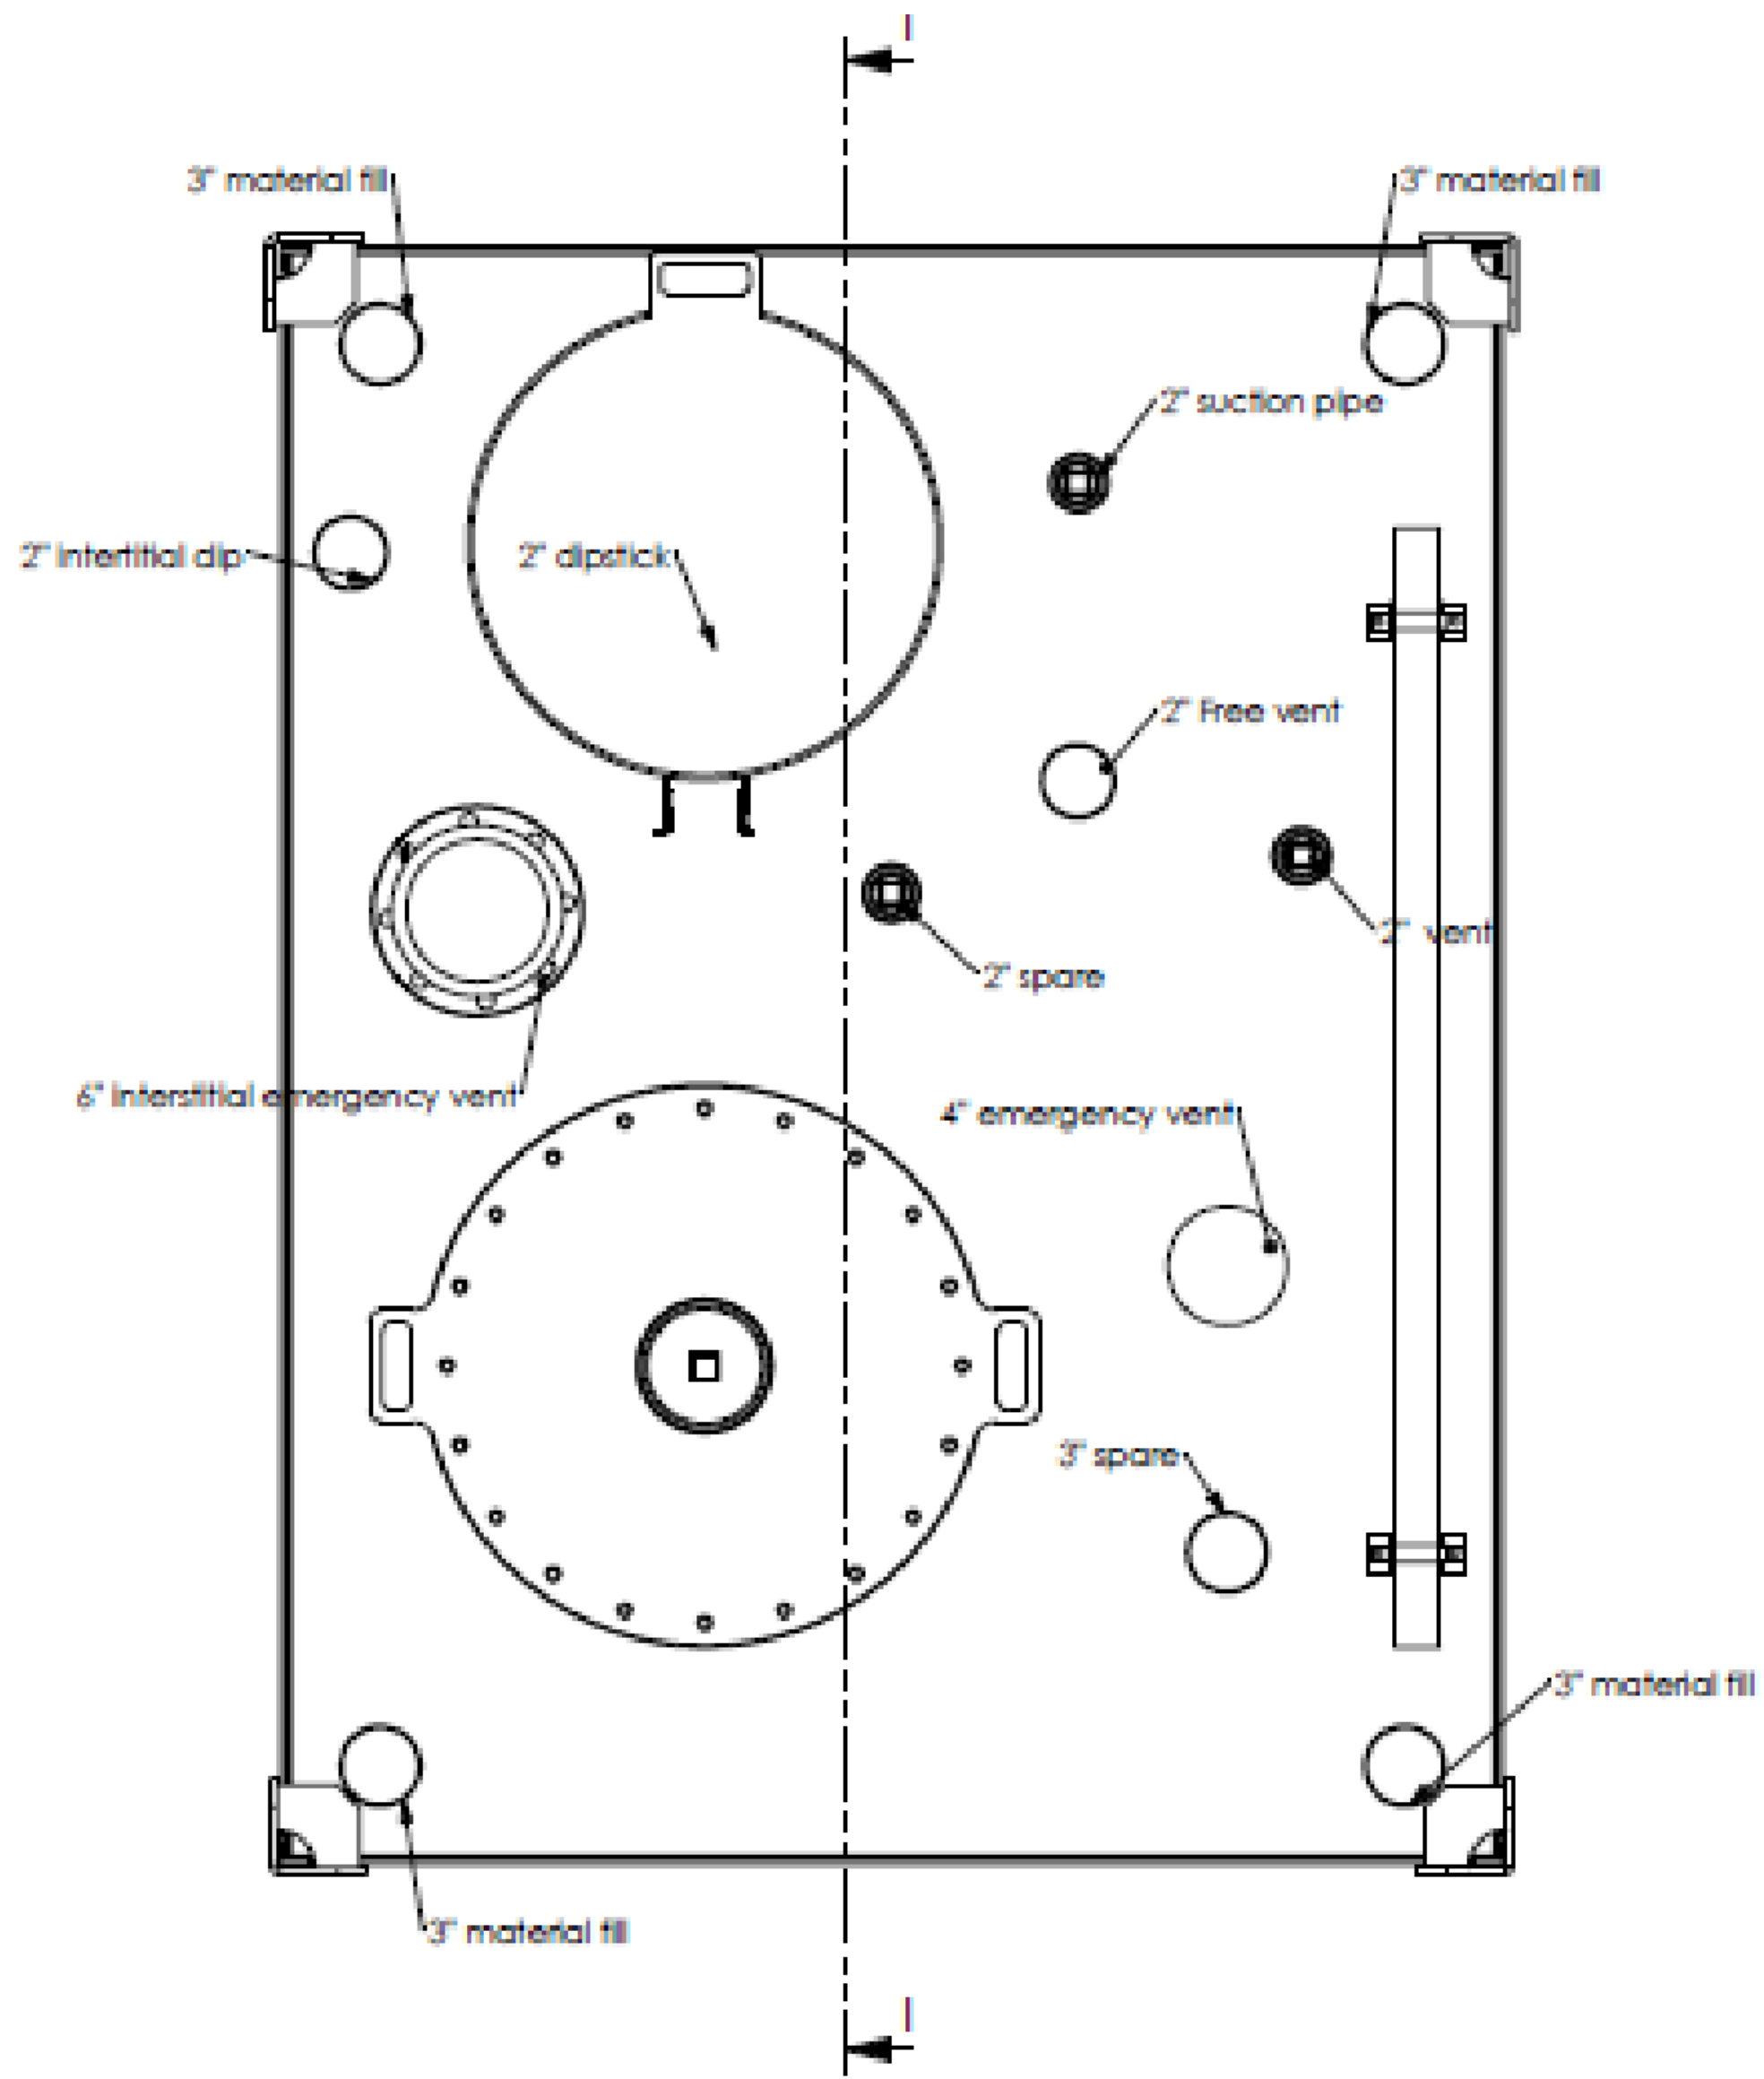

**IF IN DOUBT ASK.  
DRAWING INFORMATION TAKES PRECEDENCE OVER PARTS LIST**



**GENERAL NOTES**  
DO NOT SCALE  
UNLESS STATED OTHERWISE:-  
ALL DIMENSIONS IN MILLIMETERS  
ALL THREADS ARE METRIC COARSE  
DEBURR & REMOVE ALL SHARP EDGES  
TOLERANCES:  
TYPE RANGE TOLERANCE  
LINEAR (mm) 0 - 100 ±2.0  
101 - 1000 ±10.0  
> 1000 ±20.0  
ANGULAR (minutes) ±0.1\*

SCALE	2:1
DWN	MB
DATE	12/09/2018
CLIENT	NA
END USER	NA

TITLE	2000L Fire Rated Tank
SHEET 2 OF 2	
DRAWING NUMBER	
REV	A

