


WATER/GAS/PULSE OUTPUT TYPE METERING P-TRACKER PANEL#XXX

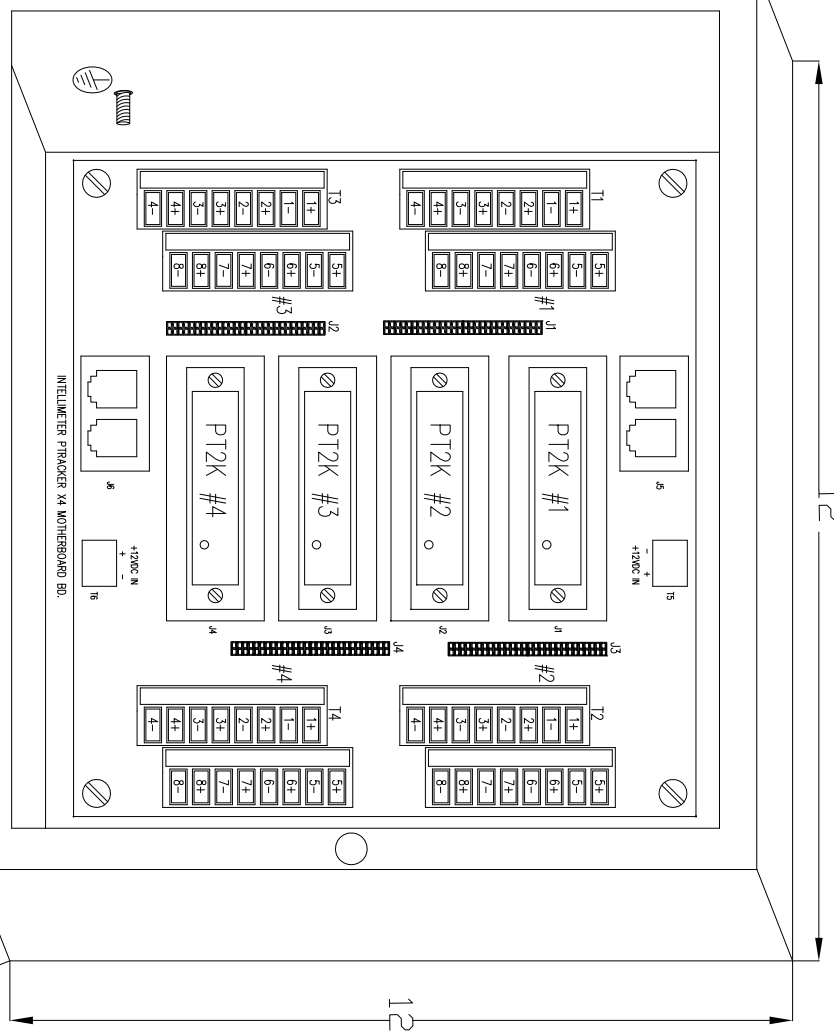

T1

CH#	SUITE#	PT2K #1	SUITE#	CH#
01				05
02				06
03				07
04				08

T2

CH#	SUITE#	PT2K #2	SUITE#	CH#
01				05
02				06
03				07
04				08

T3

CH#	SUITE#	PT2K #3	SUITE#	CH#
01				05
02				06
03				07
04				08

T4

CH#	SUITE#	PT2K #4	SUITE#	CH#
01				05
02				06
03				07
04				08

**NOTE: FOR ALL PULSE OUTPUT
TYPE METER CABLE TO BE
#20 AWG TWISTED PAIR SHIELD (MIN).
* SHIELED TO BE GROUNDED IN PANEL.**



revision	date
A	
B	
C	

Project Name: _____

Engineer: _____

Manufacturer: _____

Rev. No./Date: _____

Contractor: _____

Drawn By: HOSEIN PAKKIN

Date: APR. 21, 2005

P.O.# _____

Drawing Number: _____

Project Number: _____

Drawing: _____