


TYPICAL MECHANICAL SUBMETERING SYSTEM OVERVIEW

NOTE: PLEASE PROVIDE US WITH A LIST OF THE BTU METER'S SERIAL NUMBERS AND THE ROOM NUMBERS THAT CLEARLY INDICATES WHICH METERS ARE INSTALLED IN WHICH ROOM. OUR SERVICE TEAM NEEDS THIS INFORMATION TO PROGRAM THE METERS AND DCU

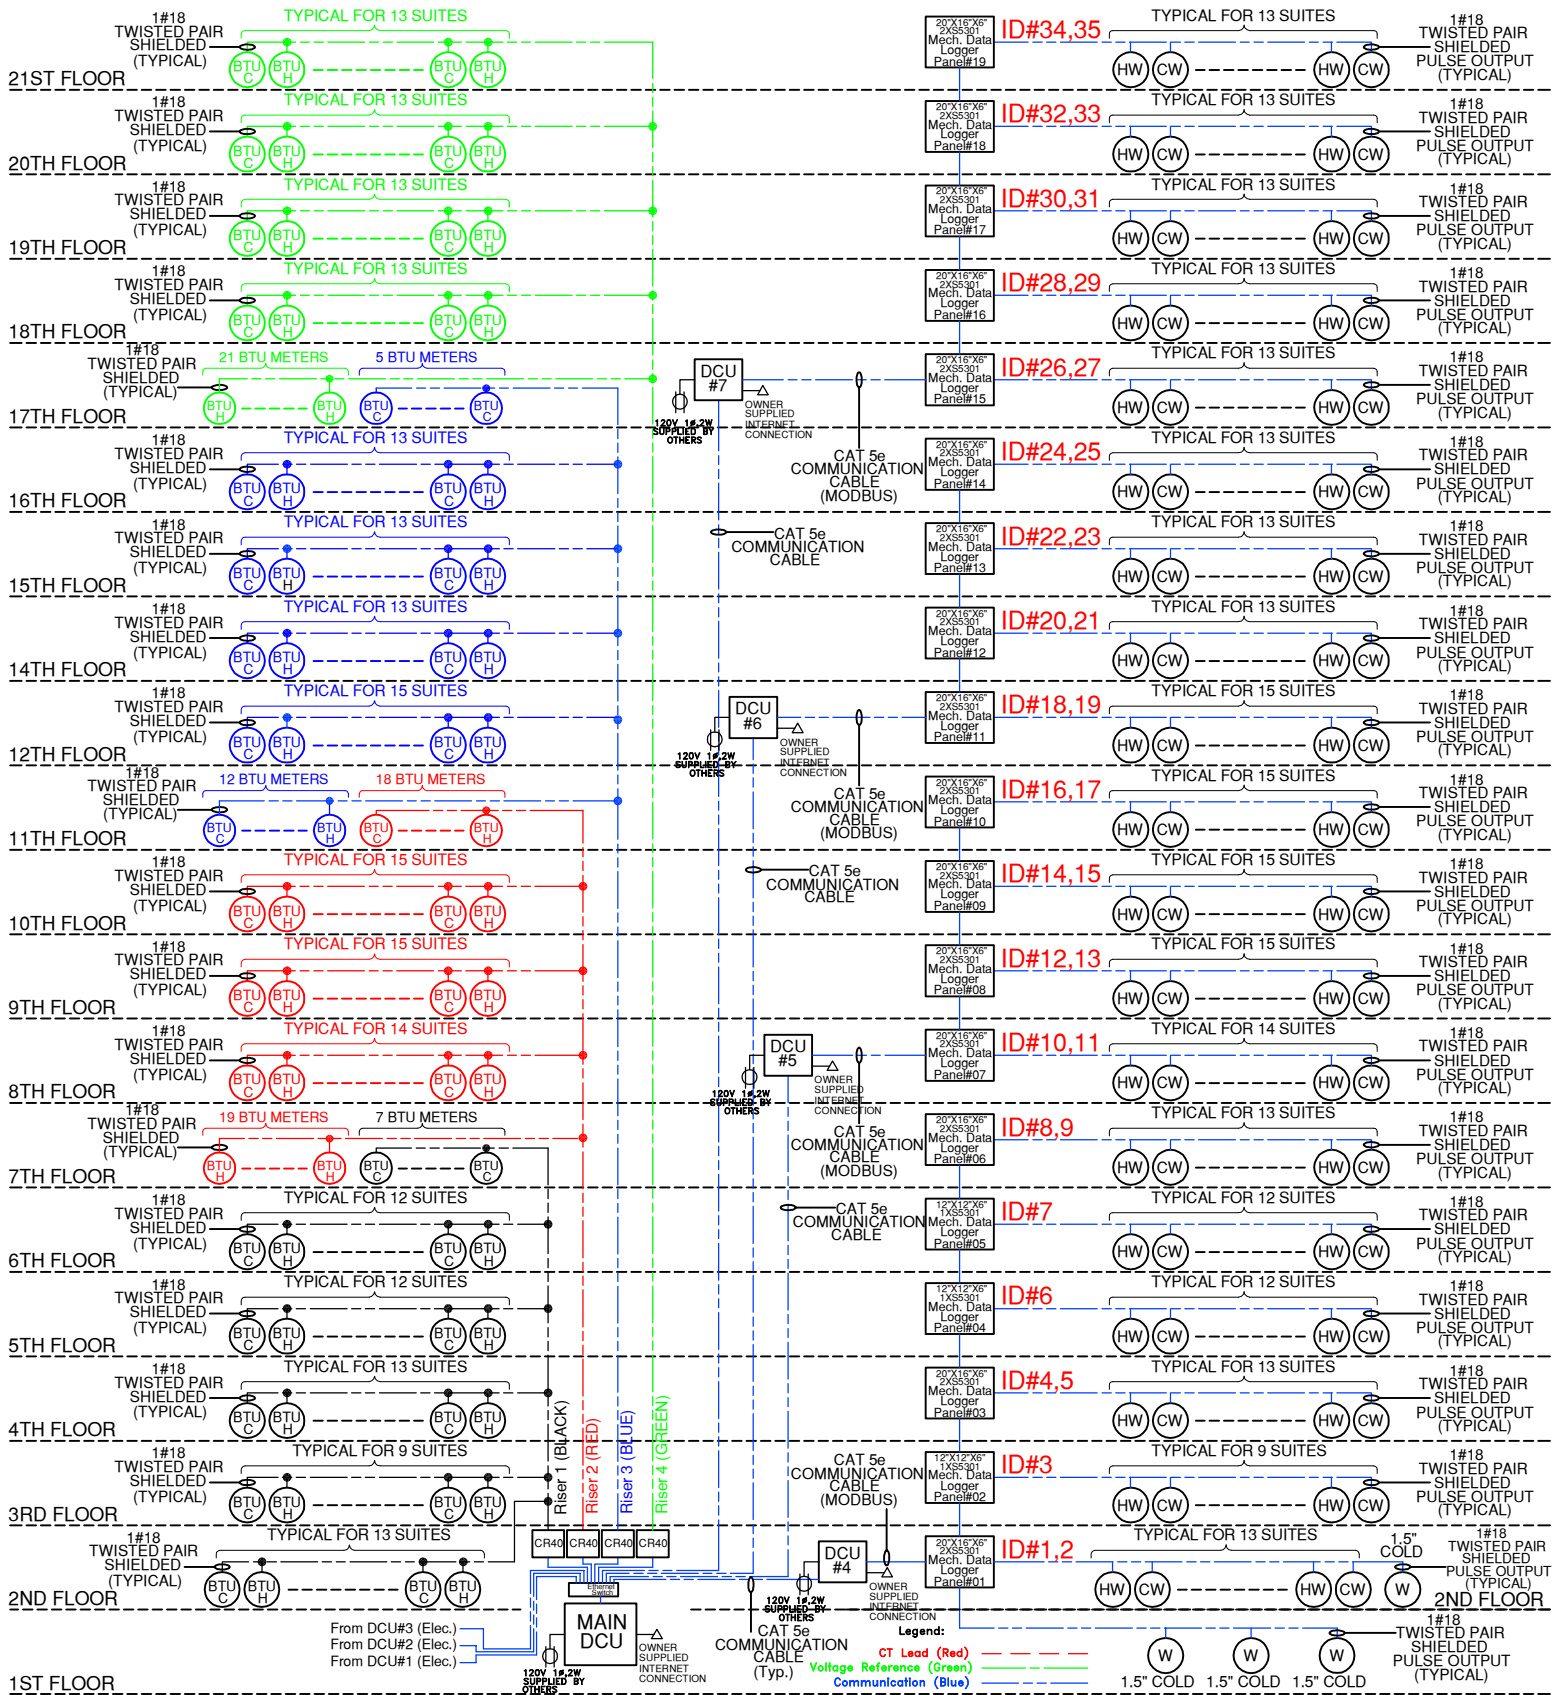

From DCU#3 (Elec.)
 From DCU#2 (Elec.)
 From DCU#1 (Elec.)

120V 1# 2W SUPPLIED BY OTHERS
 120V 1# 2W SUPPLIED BY OTHERS
 120V 1# 2W SUPPLIED BY OTHERS
 120V 1# 2W SUPPLIED BY OTHERS

MAIN DCU
 OWNER SUPPLIED INTERNET CONNECTION

CAT 5e COMMUNICATION CABLE (MODBUS)
 CAT 5e COMMUNICATION CABLE (MODBUS)
 CAT 5e COMMUNICATION CABLE (MODBUS)
 CAT 5e COMMUNICATION CABLE (MODBUS)

Legend:
 CT Lead (Red)
 Voltage Reference (Green)
 Communication (Blue)

1.5" COLD
 1.5" COLD
 1.5" COLD