



HomeSitter HS-700E

Installation and Operations Manual

**Emerson Control Products Inc.
1724 Lake Drive West
Chanhassen, MN 55317**

Document No. 42420127A

Table of contents

Cautions and warnings	4	Phone test.....	14
Description	5	Testing your HS-700E.....	15
Physical description	5	Testing for a specific alarm condition	15
General description	5	Ring count timer.....	15
LEDs.....	6	Calling the HS-700E during an alarm event Error! Bookmark not defined.	
Audible alarm	6	An in-phone line answering machine/voice mail with the HS-700E15	
What conditions activate the audible alarm?	6	How this works	15
Operation	6	Calling the HS-700E during an alarm event with an answering machine..	16
HS-700E normal operation.....	6	How to cancel an alarm call out sequence	16
How the HS-700E receives power	6	Canceling an alarm call out sequence while listening to an alarm message	16
Alarm operation	7	Canceling an alarm call out sequence by calling the HS-700E ..	17
How the HS-700E handles an alarm condition	7	Canceling an alarm call out sequence with an answer machine/voice mail device in the phone line with the HS-700E	17
DIP switch functions and settings	7	Remote status check	17
Initial setup	8	Troubleshooting	18
Connections	8	Technical information	18
Connecting to AC power	8	Technical specification.....	18
Power up sequence.....	8	FCC statement	19
Batteries	9	Plug and jack use.....	19
Battery Handling and Safety	9	Ring equivalence number (REN) ...	19
Battery Life.....	9	Telephone network interferences...	19
Installing Batteries	9	Contact us.....	19
Connecting the water sensor.....	9	Technical support.....	19
Connecting to a phone line.....	11	Warranty	20
Connecting the HS-700E and another device to the same phone jack	11	Warrantor: Dealer, Distributor, Retailer, Manufacturer	20
Phone services and your HS-700E ...	12	Warranty and remedy	20
DSL and other digital phone services	12	Causes for termination of this warranty	20
Calls using a calling card or pager phone number	12	Warrantors' liability.....	20
Creating pauses	12	Procedures for obtaining performance for warranty	20
Calls to long distance phone numbers	12	To return a product to Emerson Control Products	21
		How to request an RGA number	21
Programming (entering phone numbers)	12		
Before you start entering phone numbers	13		
Entering phone numbers	13		
Deleting phone numbers	13		
Changing phone numbers	13		
Installation considerations	14		
HS-700E assembled	14		

Trademark

All trademarks and registered trademarks are the property of their respective owners. The HS-700E HomeSitter is a trademark of Emerson Control Products, Touch Tone® is a registered trademark of AT&T.

Copyright

© 2017 Emerson Control Products: All rights reserved. No part of this work may be reproduced or used in any form or by any means—graphic, electronic, or mechanical—without written permission from Emerson Control Products.

Purchase date and serial number

For easy future reference during technical support and service, it is recommended that you write your purchase date and serial number of the device in the spaces below. The serial number can be found on the label affixed to the bottom of the HS-700E.

PURCHASE DATE:	
SERIAL NUMBER:	

Important


Every effort has been made to ensure the information in this Installation and Operations manual is complete, accurate, and up-to-date. Emerson Control Products and its vendors assume no responsibility for the result of errors in this manual, nor can it guarantee that changes in equipment and components made by other manufacturers, in reference to this manual, will not affect the operation or intended use of the HS-700E.

Cautions and warnings

Cautions indicate the possibility of poor equipment performance or potential damage to the equipment. Warnings indicate the possibility of injury to persons. The symbols shown below identify Cautions and Warnings:



Cautions and warnings appear here and may appear throughout this manual where appropriate. Failure to read and understand the information identified by these symbols could result in poor equipment performance, equipment damage, or injury to persons.



- Do not install the HS-700E in a confined space, such as a bookcase, in a cabinet, in direct sunlight, or where it might get exposed to water. Failure to observe this caution could result in poor performance or damage to the HS-700E.
- Any changes or modifications to this equipment not expressed in this manual could cause poor performance or damage to the HS-700E and will void warranty.
- The use of any accessory not recommended for use with the HS-700E could lead to poor performance or damage to the HS-700E.
- Use ONLY the AC power adapter sent with the HS-700E. Use of other AC power adapters could result in damage to the HS-700E.
- Do not install the HS-700E in high dust and debris areas. Failure to observe this caution could result in damage to the HS-700E.
- Do not install the HS-700E in an area with chemical fumes or corrosive vapors. Failure to observe this caution could result in damage to the HS-700E.



- Do not touch the barrel connector end of the AC power adapter with wet hands when plugged into AC power. Failure to observe this warning could result in an electrical shock.
- Do not throw batteries into a fire. Failure to observe this warning could result in an explosion.
- Do not install or connect the HS-700E to power or phone line during a lightning storm. Failure to observe this warning could result in an electrical shock.

Description

Physical description

Figure 1 identifies the parts of the HS-700E.

Figure 1: HS-700E Parts List

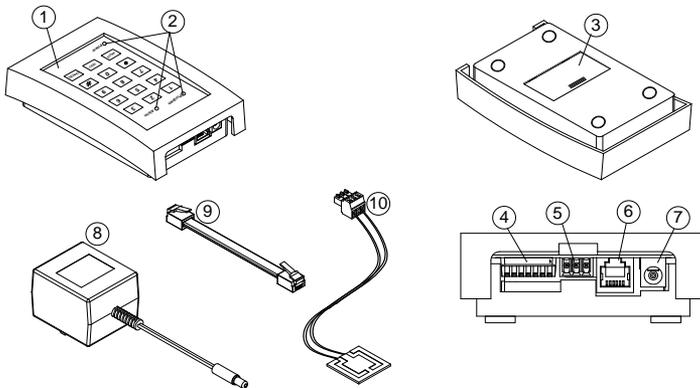


Table 1: HS-700E Parts and Purpose

Part	Purpose
1. Key Pad	Used to enter the call-to phone numbers, activate a phone test, and cancel an alarm.
2. LEDs (3)	Power, Program, and Alarm present operational status of the HS-700E. LEDs do not function when operating on battery power.
3. Battery Compartment	Accommodates two AA batteries for backup power during an AC power failure.
4. DIP Switches	These switches dictate how the HS-700E will respond to alarm conditions.
5. Water Sensor Connector	Three-position terminal block used to connect the water sensor to the HS-700E for detecting water.
6. Phone Jack	RJ-11 phone jack is used to connect the HS-700E to a standard phone line.
7. Power Jack	Connects to the AC power adapter to provide 6 volts DC power to operate the HS-700E.
8. AC Power Adapter	Converts AC power to 6 volts DC power to operate the HS-700E.
9. Phone Cord	Connects the HS-700E to the wall phone jack, length 7ft (2.1m).
10. Water Sensor	Normally open dry contact relay closes when water is detected, cable length 3ft (0.91m).

General description

The HS-700E monitors your home for a variety of alarm conditions. When an alarm event occurs, it calls the three entered phone numbers for the following alarms:

- Temperature drops below 45°F (7°C) or temperature rises above 85°F (34°C) (*DIP switch selectable*)
- AC power outages for more than 15 or 60 minutes (*DIP switch selectable*)
- HS-700E low battery condition (*backup AA batteries*)
- Water leaks (*water sensor included*)

When a problem occurs at the monitored location, the HS-700E will start calling the call-list phone numbers sequentially, over a standard phone line and describe (*in English*) the current alarm(s). The HS-700E will continue calling until the alarm call out is canceled.

LEDs

The HS-700E has three LEDs: Power, Program, and Alarm located on its front panel. These LEDs present operating status of the HS-700E. Table 2 explains the operational states of the three LEDs.

Table 2: LED Operational States

LEDs	Operational States
Power	<ul style="list-style-type: none"> • ON green when the HS-700E is plugged into the AC power adapter • OFF when operating in battery mode to preserve power
Program	<ul style="list-style-type: none"> • FLASHES red with a press of the PROGRAM key • ON red (<i>not flashing</i>) while programming phone numbers (<i>press of key 1, 2, or 3</i>) • OFF in normal operation mode • OFF when AC power fails to preserve back-up battery power
Alarm	<ul style="list-style-type: none"> • ON red when in alarm mode • OFF when in normal operation mode • OFF when AC power fails to preserve back-up battery power

Audible alarm

The HS-700E produces a 40 db beep during an alarm event. You can turn the audible alarm (*beep*) OFF for alarm conditions ONLY by setting DIP switch “6” to the DOWN position.

What conditions activate the audible alarm?

The HS-700E will beep during the following alarm events:

- Temperature alarm (*beeps once every 15 seconds*)
- Low battery alarm (*beeps once every 15 seconds*)
- Power failure (*beeps once every 10 seconds*)
- Water detection alarm (*beeps once every 15 seconds*)

Operation

HS-700E normal operation

In normal operations mode, the HS-700E:

- Monitors the ambient temperature through an on-board temperature sensor.
- Monitors for a power outage based on power through the AC power adapter (*6 volts DC*).
- Monitors the AA backup batteries for low power.
- Monitors the attached water sensor for the detection of water.

How the HS-700E receives power

The HS-700E receives power from a 6-volt AC power adapter, which comes with it. Two AA batteries (*not included*) supply back-up power to it during an AC power failure.

Alarm operation

The HS-700E will monitor and send a factory-recorded voice message to the entered phone numbers for the following alarms:

- If the temperature falls below 45°F (7°C) or rises above 85°F (34°C) (*DIP switch selectable*)
- If power is out for either 15 or 60 minutes (*DIP switch selectable*)
- If the unit encounters a low battery condition
- If the HS-700E detects water from the water sensor


How the HS-700E handles an alarm condition

Stage	Description
A.	When an alarm occurs, the alarm LED lights up (<i>if not an AC power failure</i>), and it emits a beep every so many seconds depending on the alarm type.
B.	It starts calling the call-list phone numbers in sequence, attempting to deliver an in-progress alarm voice message. If it receives a busy signal or no answer after 10 rings, it will immediately hang up and start calling the next phone number in sequence.
C.	It will continue calling the call-list phone numbers, in sequence, every 15 or 120 minutes (<i>DIP switch selectable</i>) until a called party answers.
D.	When the called party answers (<i>person or answering machine</i>), it will deliver its factory pre-recorded alarm message, identifying the specific alarm condition(s).
E.	It will continue its calling sequence until the following action is taken: <ul style="list-style-type: none"> • Locally, press the CANCEL key on the key pad. • Remotely, over the phone, press the number “1” key and then the “#” key anytime during the alarm message.
F.	Once the alarm call-out sequence is canceled, it will do one of two things: <ul style="list-style-type: none"> • If alarm is active, it allows you to call to hear the current alarm condition. • If alarm condition has been corrected, it will not respond to the incoming call.
G.	When you cancel an alarm call out sequence, and correct the cause of the alarm, it will stop beeping, the alarm LED will go out, and the unit will reset to normal operation automatically. Note: During an AC power failure alarm, the Alarm and Power LEDs do not turn ON to preserve battery power—but the unit will still beep every so many seconds.

DIP switch functions and settings

The HS-700E has a 7-position DIP switch. The switch settings determine how it will respond to specific alarm conditions. Figure 2 shows the DIP switch and Table 3 explains the functions of each switch. Turn the HS-700E upside down as shown in Figure 2 for proper DIP switch orientation.

Figure 2: DIP Switches

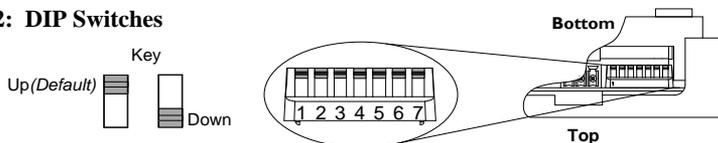

Note: Use a ballpoint pen or similar small object to set the DIP switches.

Table 3: DIP switch settings and functions

Switch	Function (<i>switch in UP position is the default</i>)
1	Temperature low or high: <ul style="list-style-type: none"> • UP, when the monitored environment temp falls below 45°F (7.2°C) an alarm message is sent. • DOWN, when the monitored environment temp rises above 85°F (29.4°C) an alarm message is sent.
2	Pick-up ring count when calling your HS-700E to cancel an alarm: <ul style="list-style-type: none"> • UP, “5” rings before the HS-700E will answer. • DOWN, “10” rings before the HS-700E will answer.
3	Monitors call out frequency: <ul style="list-style-type: none"> • UP, call sequence happens every 15 minutes. • DOWN, call sequence happens every 120 minutes. When the monitor goes into alarm mode, it begins calling the three call-list phone numbers. If the alarm condition is not canceled, the calling cycle will start again every 15 or 120 minutes until the alarm is canceled.
4	Power out alarm timer: <ul style="list-style-type: none"> • UP, if AC power is OFF for 60 minutes, an alarm message is sent. • DOWN, if AC power is OFF for 15 minutes, an alarm message is sent.
5	Auxiliary alarm message: <ul style="list-style-type: none"> • UP, if the water sensor detects water, an alarm message is sent. • DOWN, if an auxiliary event is sensed, an alarm message is sent. An auxiliary event may be some other device that is plugged into this unit that uses a dry contact. No other devices come included with this product.
6	Audible alarm: <p>UP, HS-700E will beep upon detecting an alarm condition. DOWN, HS-700E will NOT beep upon detecting an alarm condition. The alarm will beep during certain key pressing during set up or when entering test mode regardless of the switch position setting.</p>
7	Not used.

Initial setup

Connecting to AC power



- Do not touch the barrel connector end of the AC power adapter with wet hands when plugged into AC power. Failure to observe this warning could result in an electrical shock.
- Do not install or connect to power or phone lines during a lightning storm. Failure to observe this warning could result in an electrical shock.

Power up sequence


Upon power up, the HS-700E LEDs will do the following:

- The Power, Program, and Alarm LEDs will light up for a few seconds, then the Program and Alarm LEDs will turn OFF
- The Power LED will remain ON

Note: A surge protector is recommended, but not provided. You can purchase a surge protector from Emerson Control Products or from a local computer or hardware store.

To connect AC power to the HS-700E through the AC power adapter, follow the number sequence shown in Figure 3.

Figure 3: Connecting the AC Power Adapter

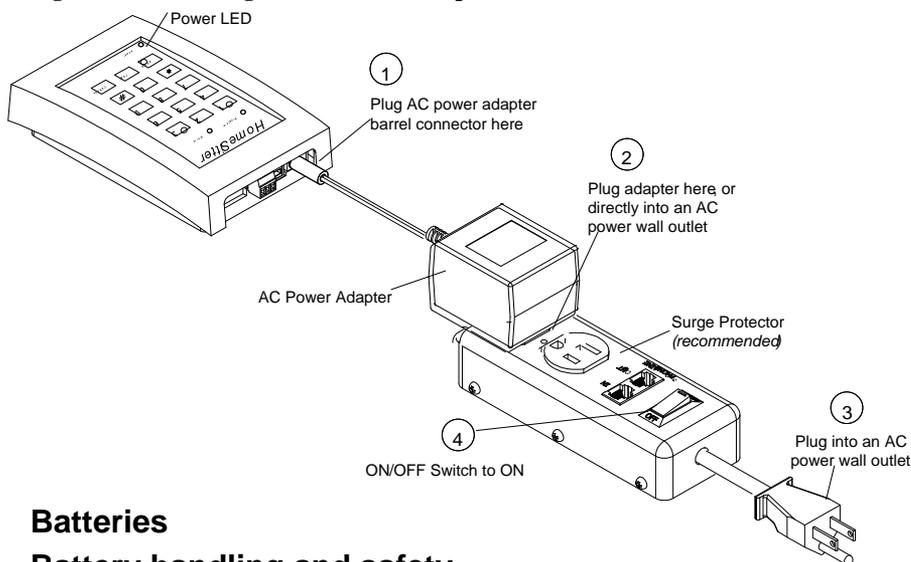

Batteries

Battery handling and safety



Do not throw batteries into a fire. Failure to observe this warning could result in an explosion.

Note: REMOVE the batteries when the HS-700E is not in service.

Battery life

If the back-up battery voltage drops below 2.35 volts, a low battery alarm will be sent, even when the unit is powered by the AC power adapter. The HS-700E will call the call list phone numbers and issue a low battery alarm message. If the unit is operating on battery power only (*after an AC power failure*), the calling sequence will continue until battery power drops to approximately 1.9 volts. Typically, most good alkaline batteries should provide approximately 12 hours of continuous power.

Note: If the low battery alarm was due to an extended AC power failure, it is recommended that you replace the batteries. Also, a false low battery alarm can occur if the AA batteries have not been installed and AC power is connected to the HS-700E.

Important

You CANNOT enter phone numbers when the HS-700E is running only on battery power.

Note: The HS-700E uses two AA batteries for backup power (not included).

Installing the batteries


Note: To avoid a false low battery alarm, please connect the AC power adapter to the HS-700E and the wall outlet before inserting batteries.

To install the batteries, follow the Steps shown in Figure 4.

Figure 4: Battery Installation Connections


Step 1

- Press down on the cover and push in the direction of the arrow to loosen and remove the cover.

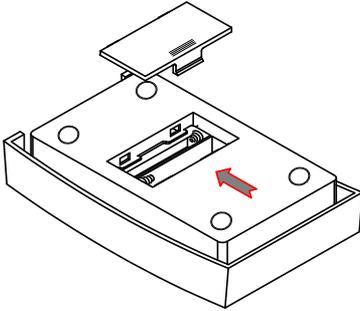

Step 2

- Install the AA batteries as shown-- note the polarity.
- Replace the battery cover.

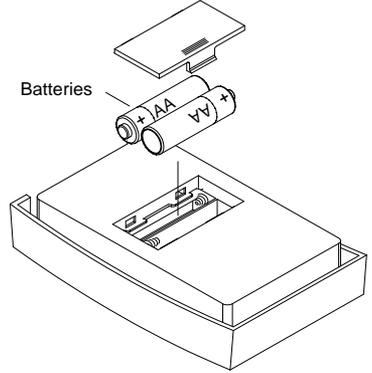


Connecting the water sensor

To connect the water sensor to the HS-700E, do the following:

Figure 5: Water Sensor Connected to HS-700E


Note: You can lengthen the cable of the water sensor to 100ft (30.8m), using the equivalent size wire. (24 gauge, 2 conductor wire)

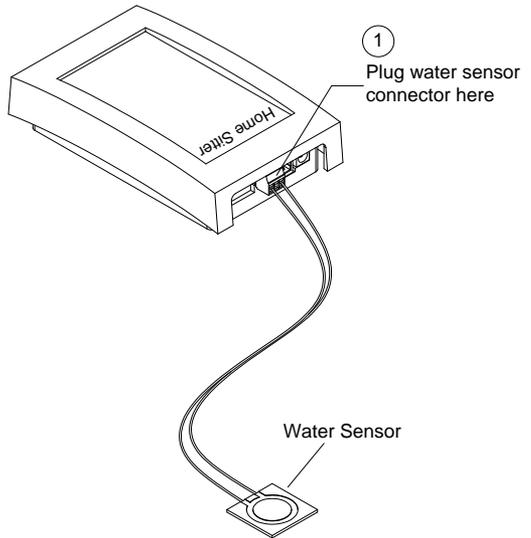

Connecting to the standard phone line

To connect the HS-700E to a phone line, do the following:

Figure 6: HS-700E Connected to Phone Line

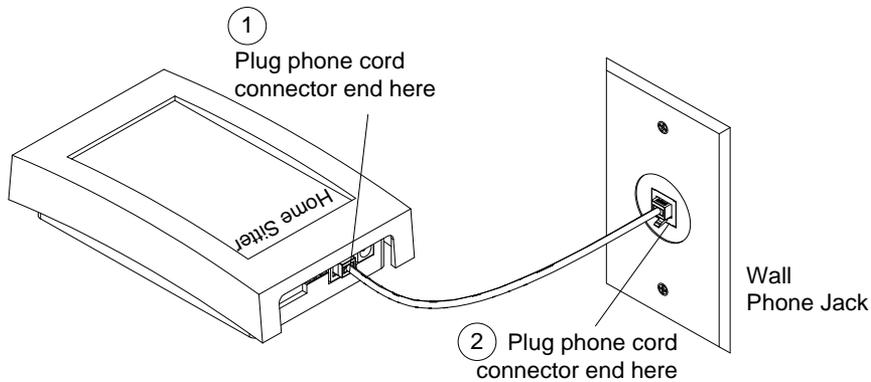

Connecting the HS-700E and another device to the same phone jack

If you need to connect the HS-700E and some other device, such as a telephone, to the same wall phone jack, simply use a phone jack splitter (*not provided*). To use a splitter, do the following:

Step	Action
1.	Plug the line splitter into the wall jack as shown in Figure 7.
2.	Plug one phone card into one jack on the line splitter, as shown in Figure 7.
3.	Plug the second phone card into the other jack on the line splitter.
4.	Plug the other end of the one phone cord into the HS-700E.
5.	Plug the other end of the remaining phone cord into the phone or other device.

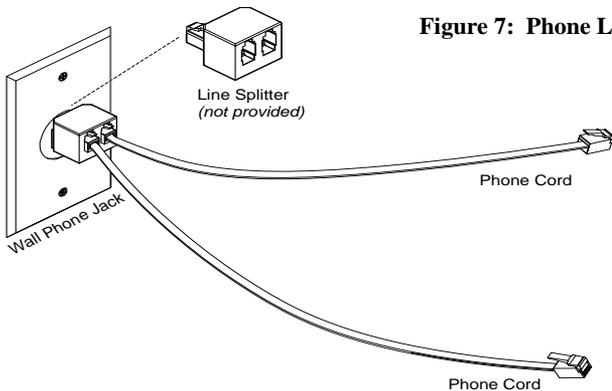


Figure 7: Phone Line Splitter

Note: Both units will operate from the same jack independently without cross interference. Line Splitters can be purchased at most hardware and electronic stores.

Phone services and your HS-700E

DSL and other digital phone services

Please note that the HS-700E is designed and certified by the FCC to operate on a standard telephone line, provided by your local telephone company. DSL, Cable, or Digital phone service may work with the appropriate in-line filters. If you have questions or problems using one of those types of phone services, contact that specific phone service provider for assistance.

Note: The HS-700E dials out using touch tone dialing only.

Important

During power failures, many alternative phone services such as DSL, Digital and Cable provided phone service DO NOT WORK. Those phone services require that power be on at the location for the phone to operate. The HS-700E will NOT be able to call out if the power is out when using these phone services. If you have a standard telephone line, power is supplied to this line by the telephone company and is usually not affected when power goes out at the monitored location.

Calls using a calling card or pager phone number

When using a calling card or pager system, you often need to include pauses to ensure that enough time is allotted to dial the phone number. To get a sense for how much time that may be needed, call the preferred calling card or pager to gain an understanding of how that system works. Often times, the calling card or pager system, may announce “enter your calling card number followed by the pound (#) key.” Make sure to include all necessary key presses as you enter the number. Also, while the card or pager system is talking (*number of seconds*), you will need to enter pauses for that time to allow the system adequate time to accept your telephone number.

Creating pauses

You can add pauses to your telephone number as you enter it into the HS-700E by pressing the STAR (*) key two times, which represents a 2-second pause. If you need to enter a 6-second pause, press the * key six times.

Note: Always press the * key twice (*in multiples of 2*) to create an effective pause; otherwise, a single press of the * key will be literally translated as part of the dialed phone number.

Calls to long distance phone numbers

Long distance calling: make sure you enter the phone number exactly as you would when dialing a long distance call yourself (“1” and area code if needed). If dialing internationally, make sure you have the correct country codes and follow proper international dialing rules. Check with your phone company for assistance to determine the correct number.

Programming (*entering phone numbers*)

You can program the HS-700E with up to three phone numbers (*60 digits each*), which it uses to communicate alarm messages.

Before you start entering phone numbers

Important

- DO NOT enter phone numbers of emergency services (*fire, police or ambulance*).
- DO NOT forget the area code and enter the phone number exactly as you would when making a personal phone call.
- Long distance dialing: enter “1,” the area code if required, and then the phone number. It is critical that you run a system test to validate the call-to numbers. For proper testing, it is recommended that a person at the call-to location confirms receiving the call.

Note: You cannot enter phone numbers when the HS-700E is running only on battery power.

Entering phone numbers

Note: Phone numbers are stored in non-volatile memory (*permanently stored in the HS-700E regardless of power failures or long-term storage*).

To enter phone numbers into the HS-700E, do the following:

Step	Action
1.	Make sure the HS-700E is in normal operation mode.
2.	Press PROGRAM key - a beep and the program LED starts flashing.
3.	Press the number “1” key to select the 1st location - a beep and program LED is ON, not flashing.
4.	Enter the phone number (<i>up to 60 digits</i>) - beeps with each key press.
5.	Press PROGRAM key - a beep and the program LED will start flashing. The number was entered successfully and the unit is still in program mode.
6.	Press the number “2” followed by a phone number to add the 2nd phone number.
7.	Press the PROGRAM key - a beep and the program LED will start flashing. The number was entered successfully and the unit is still in program mode.
8.	Press the number “3” followed by a phone number to add the 3rd phone number.
9.	Press the PROGRAM key-this will save the final programmed number
10.	Press the PROGRAM key again to exit program mode - a beep and the program LED goes out. (<i>if programming less than 3 phone numbers, enter the Program Key to exit programming mode when complete. The program LED will go out</i>)

Deleting phone numbers

To delete a phone number, do the following:

Step	Action
1.	Press the PROGRAM key - a beep and the program LED starts flashing.
2.	Press the number 1, 2, or 3 key of the location of the phone number you want to delete - a beep and the program LED is ON, not flashing.
3.	Press the PROGRAM key to delete the phone number - a beep and the programming LED starts flashing. The number was deleted successfully.
4.	Press the PROGRAM key to exit program mode when done—a beep and the program LED goes out.

Changing phone numbers

Follow the “entering phone number” procedure to overwrite any or all three phone numbers.

Installation considerations

The HS-700E should be installed in a dry, clean location near an AC power outlet and a telephone wall jack, as shown in Figure 8.

Warning

- Do not install or connect to power or phone lines during a lightning storm. Failure to observe this warning could result in an electrical shock.

Caution

- Do not install in a confined space, such as a bookcase, cabinet, in direct sunlight, or where it might get exposed to water. Failure to observe this caution could result in poor performance or damage.
- Use **ONLY** the AC power adapter provided. The use of other AC power adapters could result in damage.
- Do not install in high dust and debris areas. Failure to observe this caution could result in damage.
- Do not install in an area with chemical fumes or corrosive vapors. Failure to observe this caution could result in damage.

HS-700E assembled

Figure 8 shows an example of an ideal setup of the HS-700E fully assembled. Place the HS-700E on any flat surface, preferably a table top near an AC Power outlet and a phone jack as shown in Figure 8. Once it is fully assembled and operational (*power LED ON*), perform a phone test to ensure that it can call the call-list phone numbers during an alarm.

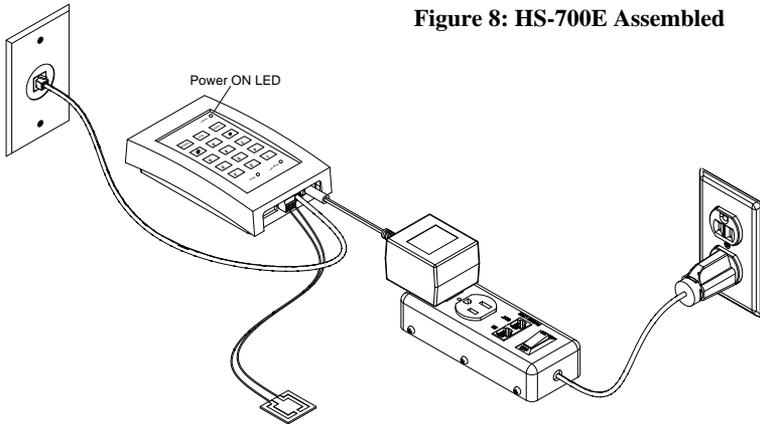


Figure 8: HS-700E Assembled

Phone test

After entering all phone numbers, it is crucial that you test your HS-700E to verify that it can reach the call list phone numbers.

Note: The CANCEL key does not function when the HS-700E is in “test mode.”

Testing your HS-700E

To test the HS-700E, do the following:

Step	Action
1.	Make sure the HS-700E is powered up and in normal operation mode.
2.	Press the TEST button—the HS-700E beeps and the alarm LED starts flashing.
3.	Press the number 1, 2, or 3 key of the phone number that you want to contact - a beep and the alarm LED is ON, not flashing. The following will occur: <ul style="list-style-type: none">• It will immediately dial the desired phone number stored at key pad location 1, 2, or 3.• Upon answering, it will play the following message: “This is a test of the HomeSitter Alarm.”• It will repeat this message for approximately “1” minute and then hang up, and the alarm LED will go out.
4.	Repeat Steps 2 and 3 to test the remaining phone numbers.

Important

The HS-700E does not provide any indication of call success; therefore, you must verify that the call was made successfully.

Testing for a specific alarm condition

To test for a specific alarm condition (*temperature, water, power*) you will need to simulate that specific alarm condition and then verify if the alarm phone calls went through. In those scenarios, you must cancel the alarm call out sequence and correct the alarm condition.

Ring count timer

The ring timer works in the following way: when the first call comes in during an alarm event, the timer starts counting down for “3” continuous minutes. If the HS-700E receives enough rings to answer (*within “3” minutes*), it will respond, and the ring counter will reset to “0” regardless if the three minutes have elapsed or not. Also, the timer will reset to “0” if no additional calls are received during a three minute period (*multiple calls to the HS-700E within “3” minutes will not reset the ring timer*).

An in-phone line answering machine/voice mail with the HS-700E

When it is necessary to connect an answering machine or voice mail device to the same phone line as the HS-700E, you can still use all the features of these devices, along with being able to check status and cancel an alarm call out of the HS-700E.

How this works

- During setup, you can manually set the HS-700E to answer on a specified number of incoming rings “5” or “10” (*DIP switch 2, ring count*).
- Set your answering machine or voice mail to answer in fewer rings than the HS-700E. (*For example, if the HS-700E is set to answer on 5 rings, set the other device to answer in “4” or fewer rings.*) Therefore, when a call comes into the location of the HS-700E, the answering machine/voice mail will respond first because it is set to answer in fewer rings than the HS-700E.

Calling the HS-700E during an alarm event with an answering machine / voice mail connected

The following example shows how to call the HS-700E during an alarm event:

Criteria

- HS-700E ring count is set to “5” rings to answer (*factory default DIP switch setting*).
- Answering machine/voice mail is set to “4” rings to answer.
- You must make the appropriate number of phone calls to the location where the HS-700E is within “3” minutes or the timer in the HS-700E will reset to “0.”

To get the HS-700E to respond given the above example criteria, do the following:

Step	Action
1.	Call the phone number of the location where the HS-700E is located, and let the phone ring “3” times and then hang up. The internal 3-minute timer starts and the HS-700E counts and remembers the number of rings.
2.	On your second call within “3” minutes, let the phone ring until the HS-700E answers. The HS-700E will answer first because it remembered the first “3” rings, and then it added the rings from the second call until the total reached “5,” then it answered before the answering machine/voice mail device (“4” rings to answer).
3.	Listen to the alarm message.

Note: If the HS-700E is set to answer in 10 rings (*the second choice on DIP SW2*), you may need to place more calls within “3” minutes to get the HS-700E to eventually answer.

How to cancel an alarm call out sequence

You can cancel an alarm call out sequence in two ways:

- Remotely, press the number “1” key and then the pound (#) key at any time during the alarm message.
- Locally, press the CANCEL key on the key pad.

Canceling an alarm call out sequence while listening to an alarm message

To cancel a call out sequence while listening to an alarm message, do the following:

Step	Action
1.	Pickup the phone.
2.	Listen to the alarm message.
3.	When told, press the number “1” key.
4.	Press the pound (#) key within “1” minute to cancel the alarm call out.
5.	You can listen until you hear the HS-700E say goodbye or just hang up the phone.

Note: Canceling the call out sequence does not cancel an active alarm (*the HS-700E will continue to beep and the alarm LED will be lit*).

Canceling an alarm call out sequence by calling the HS-700E

To cancel a call out sequence during an active alarm, do the following:

Step	Action
1.	Make the call to the HS-700E (<i>phone number at alarm location</i>)
2.	Wait for the HS-700E to answer (<i>5 or 10 rings—DIP switch selectable</i>)
3.	Listen to the alarm message.
4.	Press the number “1” key.
5.	Press the pound (#) key anytime during the message to cancel the alarm call out.
6.	Hang up the phone.

Canceling an alarm call out sequence with an answer machine/voice mail device on the same phone line

To cancel the alarm call out-sequence, do the following:

Step	Action
1.	Make the call to the HS-700E (<i>phone number at alarm location</i>).
2.	Let the phone ring the desired number of times (<i>before the other in-line device can answer</i>).
3.	Hang the phone up.
4.	Call the number a second time within three minutes (<i>The HS-700E keeps track of the rings from the previous calls, accumulates them until the total ring count matches its ring count number 5 or 10, and then it will answer</i>).
5.	Listen to the alarm message.
6.	Press the number ‘1’ key.
7.	Press the pound (#) key anytime during the message to cancel the alarm call out.
8.	Hang up the phone.

Remote status check

During normal operation, the HS-700E will not answer any incoming calls. You can call the HS-700E and get a response:

- If the HS-700E is in alarm mode.
- If the call out sequence has been cancelled for an alarm, but the alarm condition still exists, the HS-700E will answer and describe the alarm condition.

Troubleshooting

Problem	Solution
Power on LED is not lit	<ul style="list-style-type: none"> • Power LED does not turn ON while running on batteries. • Is the AC adapter plugged into the HS-700E and into a ‘live’ AC power source? • Is the AC power wall outlet active?
CANNOT enter phone numbers	<ul style="list-style-type: none"> • You cannot enter phone numbers if the HS-700E is being powered only by batteries. • Is the AC power adapter plugged into AC power? • Follow the “Entering Phone Number” procedure.
HS-700E DOES NOT call out during a test	<ul style="list-style-type: none"> • Does the HS-700E have power? • Is the phone service working properly (<i>dial tone</i>)? • Re-check that the RJ-11 phone cord is fully plugged into the phone jack of the HS-700E, and into the wall jack. • Re-enter the phone numbers, verify area code and if the number “1” is required for long distance calling. • If using a calling card, check to see that the calling sequence includes pauses as may be necessary to complete the call.
HS-700E does not answer when I call	<ul style="list-style-type: none"> • It will not answer if there is no active alarm event in progress. • Is there an answering machine or voice mail in line with the unit? • Verify that phone service is active at HS-700E location.
I cannot cancel the alarm call out; the HS-700E continues calling out	<ul style="list-style-type: none"> • Do you hear an alarm message that the alarm call out has been canceled? • Are you pressing the correct cancel alarm keys during the alarm event: number “1” key and then the pound “#” key within one minute?
Receiving a false alarm	<ul style="list-style-type: none"> • The temperature sensor is accurate to within 3°F of the actual temperature. If it is too close to a window during the winter months or positioned in direct sun light this could cause a false alarm. • Check to see if the batteries installed, No batteries could cause a false alarm.

Technical information

Technical specification

Specification	Description
Power requirements	Two power sources: <ul style="list-style-type: none"> • 110VAC power adapter voltage stepped down to 6VDC, 200mA. • 2 AA batteries for backup power (<i>alkaline or lithium, not provided</i>) CHANGE BATTERIES after a prolonged AC power failure or yearly.
Sensor	Fixed setpoint, internal sensor
Operating Humidity Range	95% non-condensing
Dimensions	5.8in L, 3.5in W, 1.5in H (<i>147.3mm, 88.9mm, 38.1mm</i>) approximately
Accuracy	±3° F (2°C)

FCC statement

This equipment complies with Part 68 of the FCC rules and the requirements adopted by the ACTA (*American Council for Terminal Attachments*). On the bottom of your HS-700E is a label that contains, among other information the **FCC registration number** for this product. If requested, this number must be provided to the telephone company.

Plug and jack use

A plug and jack used to connect this equipment to the premises wiring and telephone network must comply with the applicable FCC Part 68 rules and requirements adopted by the ACTA. A compliant telephone cord and modular plug is provided with this product. It is designed to be connected to a compatible modular jack that is also compliant. See installation instructions for details.

Ring equivalence number (REN)

The REN is used to determine the number of devices that may be connected to a telephone line. Excessive REN's on a telephone line may result in the devices not ringing in response to an incoming call. In most, but not all areas, the sum of RENs should not exceed five (5.0). To be certain of the number of devices that may be connected to a line, as determined by the total RENs, contact your local telephone company. The REN for this product is 0.1B and is also identified as part of the FCC product identifier shown on the label on the back of your HS-700E.

Telephone network interferences

If this HS-700E causes harm to the telephone network, the telephone company will notify you in advance that temporary discontinuance of service may be required. But if advance notice isn't practical, the telephone company will notify the customer as soon as possible. Also, you will be advised of your right to file a complaint with the FCC if you believe it is necessary.

The telephone company may make changes in its facilities, equipment, operations or procedures that could affect the operation of the equipment. If this happens, the telephone company will provide advance notice in order for you to make necessary modifications to maintain uninterrupted service. If the equipment is causing harm to the telephone network, the telephone company may request that you disconnect the equipment until the problem is resolved.

If your home has specially wired alarm equipment connected to the telephone line ensure the installation of your HS-700E does not disable your alarm equipment. If you have questions about what will disable alarm equipment, consult your telephone company or a qualified installer.

Contact us

800-880-6000

cpi-customerservice@emerson.com

Or visit us at:

www.controlproductsonline.com

Technical support

If you need additional help installing or using your HS-700E, contact our technical support department at 800-880-6000, Monday thru Friday, 8 AM to 5 PM CST. Or you can email your questions to: cpi-customerservice@emerson.com

Warranty

Warrantor: Dealer, Distributor, Retailer, Manufacturer

Warranty and remedy

We believe the HS-700E is a superior product. Although we take extreme pride in producing and testing a product that will function properly, we cannot guarantee that there will never be a defective unit or that a unit will function on all the thousands of phone lines and communication equipment in existence. For this reason, it must be clear that the warrantors are not insuring your premises or guaranteeing that there will not be damage to your person or property if you use this product. If you are not comfortable with our Limited Warranty, or completely satisfied with the product, we encourage you to return the unused product for a full refund within 30 days of purchase. Thank you for your understanding.

One Year Limited Warranty: Emerson Control Products warrants its product to be free from defects in material and workmanship under normal use for one year, and is not responsible for consequential damages or installation costs of any nature. In the event that the HS-700E does not conform to this warranty at any time during the period of one year from original purchase date, the warrantor will repair the defect and return it to you at no charge.

Important

The warranty is limited to replacement of the product ONLY. Secondly, because every phone line differs, we strongly encourage you to fully test this product in its actual application. This should include a full test, involving the product actually dialing to its designated locations and someone verifying the proper response.

Causes for termination of this warranty

This warranty shall terminate and be of no further effect at the time the products is

- Damaged by extraneous causes such as fire, water, power surge or spike, lightning, etc., or not maintained as reasonable and necessary
- Modified or Improperly installed
- Repaired by someone other than the warrantor
- Used in a manner or purpose for which the product was not intended

WARRANTORS' OBLIGATION UNDER THIS WARRANTY IS LIMITED TO REPAIR OR REPLACEMENT OF THE PRODUCT ONLY. THIS WARRANTY DOES NOT COVER PAYMENT OR PROVIDE FOR THE REIMBURSEMENT OF PAYMENT FOR INCIDENTAL OR CONSEQUENTIAL DAMAGES.

Warrantors' liability

It must be clear that the warrantors are not insuring your premises or guaranteeing that there will not be damage to your person or property if you use this product. The Warrantors shall not be liable under any circumstances for damage to your person or property or some other person or that person's property by reason of the sale or use of this product, or its failure to operate in the manner in which it is designed. The warrantors' liability, if any, shall be limited to the original cost of the product only. Use of this product is at your own risk.

Procedures for obtaining performance for warranty

In the event that the product does not conform to this warranty, the product should be shipped or delivered freight prepaid to warrantor with evidence of original purchase. If in any way you're not comfortable with this product or it's Limited Warranty, we encourage you to return it unused within 30 days of original purchase date, with evidence of the purchase date.

To return a product to Emerson Control Products

All products being returned to Emerson Control Products must have a valid Returned Goods Authorization Number (RGA #) from Emerson Control Products, regardless of why the product is being returned. Warranty returns will be honored only with a RGA #. Ship warranty return products prepaid to Emerson Control Products, 1724 Lake Drive West, Chanhassen, MN 55317. Emerson Control Products will, at its option, either repair or replace the product free of charge and return the repaired unit or replacement unit at the lower cost shipping prepaid. Products returned for credit are subject to a 25% restocking charge. Returns resulting from errors by the seller are not subject to this charge. All returns must include evidence of original purchase, showing purchase date. The RGA # should be clearly marked on the outside of the package containing the product.

How to request an RGA number

To request a RGA #, call Emerson Control Products at 800-880-6000 and ask for Customer Service. Failure to have a RGA # may result in lost product or significant delays in handling your return. Also, products without a RGA # Clearly Marked On The Outside Of The Package are not the responsibility of Emerson Control Products.

© 2017, Emerson Control Products

This manual may not be reproduced, modified,
or distributed without permission from Emerson Control Products

Document # 42420127A